


Service Layer Credits: MNGeo, FSA 2017
Data Source: Geronimo Energy, US Census

- ▲ SG170 Proposed Turbine
- ▭ Project Area Boundary
- Residential Structure (within 1 mile of Project Area)
- Participant
- Non-Participant
- Sound Pressure Levels (Turbine Only)
- 20 dBA
- 25 dBA
- 30 dBA
- 35 dBA
- 40 dBA
- 45 dBA
- 47 dBA

*Turbines not to scale

Figure 7b
Sound/Noise
Siemens Gamesa SG170
Plum Creek Wind Project
Redwood, Murray, and
Cottonwood Counties, MN

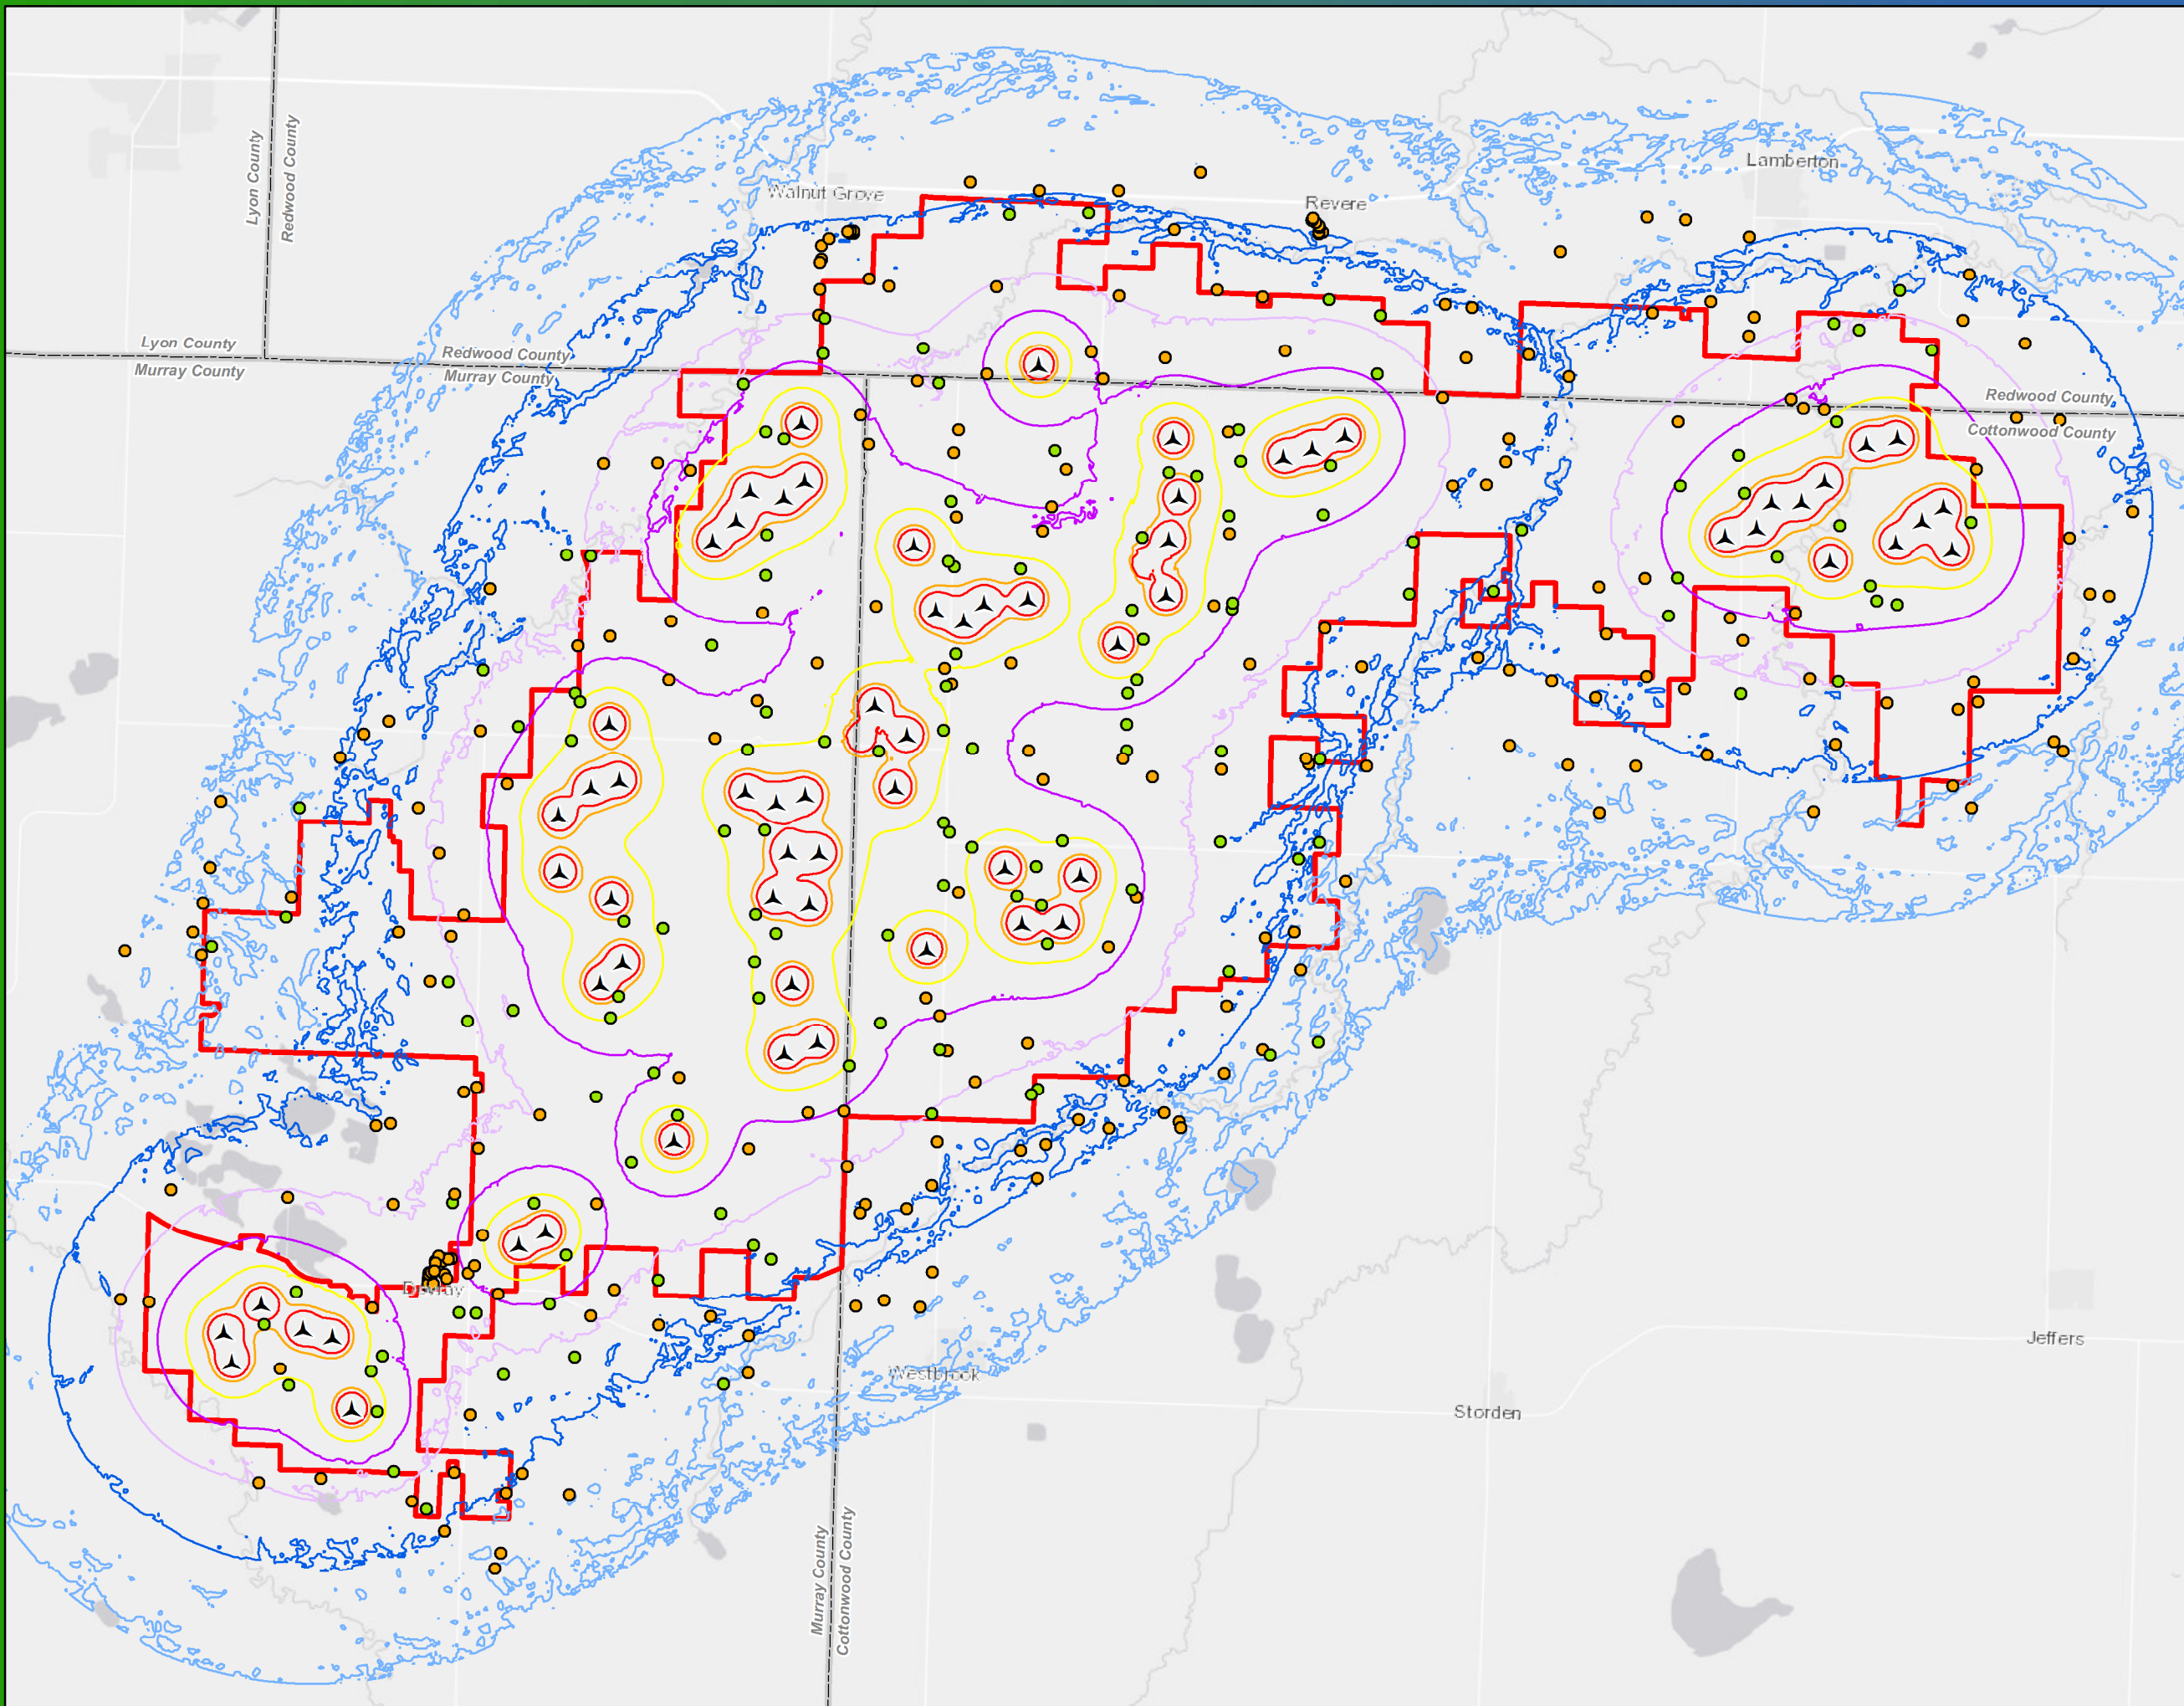