

Appendix D Agricultural Impact Mitigation Plan

Byron Solar Project

Dodge and Olmsted counties, Minnesota



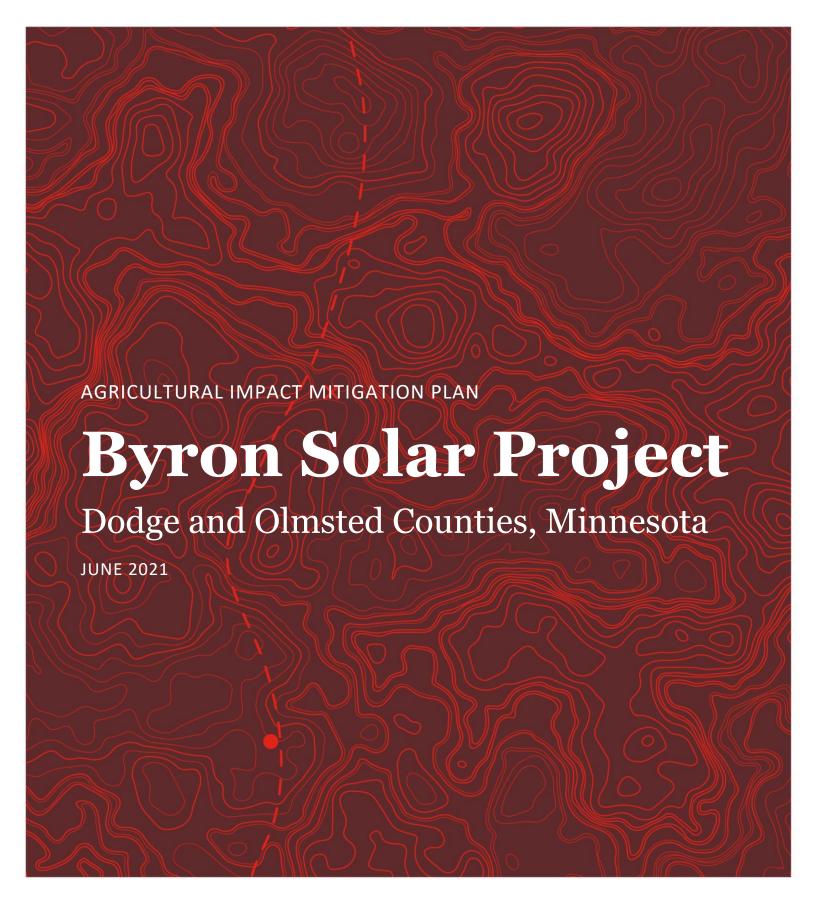

PREPARED FOR:



PREPARED BY:



Agricultural Impact Mitigation Plan

Byron Solar Project

Dodge and Olmsted Counties, Minnesota

Prepared For:

EDF Renewables, Inc. 10 NE 2nd Street, Suite 400 Minneapolis, MN 55413 (612) 486-4523

Prepared By:

Westwood Professional Services 12701 Whitewater Drive, Suite 300 Minnetonka, MN 55343 (952) 937-5150

Project Number: 0028109.00

Date: June 17, 2021

Abbreviations and Definitions

AC Alternating Current

AIMP or Plan Agricultural Impact Mitigation Plan

BMPs Best Management Practices
Byron Solar Byron Solar, LLC (Developer)
Conductor Electrical wire or cabling

Commission or PUC Minnesota Public Utilities Commission

Construction Manager Person responsible for coordination and supervision of

construction of the Project

CSAH County State Aid Highway

DC Direct Current

Decompaction Soil tillage which loosens soil compaction

Drain Tile Underground drainage system for water removal from soil

GPS Global Positioning System

HVTL Project Area 55-acre area to be used for the 345kV line connecting the Project

Substation to the Byron Substation and right-of-way for the line

kV Kilovolt

Land Control Area Approximate 3,028-acre area of privately-owned land for which

Byron Solar has leased for the Project

LCC Land Capability Class

ModuleSolar panel encapsulating several solar cellsMonitorEnvironmental scientist assigned to monitoring

MDA Minnesota Department of Agriculture

MNDNR Minnesota Department of Natural Resources

MW Megawatts

NPDES National Pollutant Discharge Elimination System Permit

NRCS Natural Resources Conservation Service
O&M Building Operations and maintenance building

Preliminary Approximate 1,553-acre area where Byron Solar proposes to build

Development Area the Byron Solar Project facilities

Project Byron Solar Project (a photovoltaic solar energy conversion

project)

Project Area Approximate 1,854-acre land area within which the Project will be

developed (1,801-acre Solar Facility and 53-acre HVTL)

PV Photovoltaic

VMP

SCADA Supervisory Control and Data Acquisition

Skid Modular steel frame or enclosure integrating electrical equipment

Vegetation Management Plan

SSURGO Soil Survey Geographic Database
SWPPP Stormwater Pollution Prevention Plan
TH Minnesota State Trunk Highway
Tile Contractor Agricultural drain tile contractor



Table of Contents

1.0	Pu	rpose and Applicability of Plan	. 1
2.0	Pro	oject Overview	2
2.1	Backgro	ound	. 2
2.2	Project	Components	. 3
	2.2.1	Configuration of Solar Panels, Arrays, and Racking	. 3
	2.2.2	Inverters, Transformers, and Electrical Collection System	. 4
	2.2.3	Project Substation and Operations and Maintenance Building	٠5
	2.2.4	Access Roads	. 5
	2.2.5	Permanent Fencing	. 5
	2.2.6	Stormwater Drainage Basins	. 6
	2.2.7	Transmission System	. 6
	2.2.8	Temporary Facilities	. 6
2.3	Constru	ıction	. 6
	2.3.1	Site Clearing & Vegetation Removal	. 6
	2.3.2	Earthwork	. 6
	2.3.3	Access Road Construction	. 7
	2.3.4	Solar Array Construction	. 7
	2.3.5	Electrical Collection System	.8
	2.3.6	Inverter Installation	.8
	2.3.7	Project Substation Construction	.8
	2.3.8	Stormwater Drainage Basins	. 9
	2.3.9	High Voltage Transmission Line Construction	. 9
	2.3.10	Project Fencing Installation	. 9
3.0	Lin	nitations and Suitability of Site Soils	9
3.1	Land U	se Considerations	10
3.2	Import	ant Soil Characteristics	10
	3.2.1 Bedroo	Selected Physical Characteristics: Texture, Slope, Drainage and Wetness, Topsoil Depth, ck and Presence of Stones and Rocks	11
	3.2.2	Selected Classification Data: Prime Farmland, Land Capability Classification, Hydric Soils.	13
	3.2.3 Prone,	Construction-Related Interpretations: Highly Erodible Land (Wind and Water), Compaction Rutting Prone, and Drought Susceptible with Poor Revegetation Potential	
	3.2.4	Summary of Major Soil Limitations at the Byron Solar Project	16
4.0	BM	Ps During Construction and Operation	17
4.1	Enviror	nmental Monitor	18
4.2	Soil Seg	gregation and Decompaction	19

4.3 Wet We	eather Conditions	19
4.4 Adaptiv	ve Management During Construction	.20
4.5 Initial (Grading/Road Construction/Array Construction	20
4.6 Founda	ations	21
4.7 Trench	ing	21
4.8 Tempo	rary Erosion and Sediment Control	21
4.9 Drain T	File Identification, Avoidance and Repair	. 22
4.9.1	Pre-Construction Tile Mapping and Repair	. 22
4.9.2	Project Design Considerations	. 23
4.9.3	Construction Measures	. 23
4.9.4	Operational Measures	. 23
4.10 Constr	ruction Debris	23
5.0 De	commissioning	23
5.1 Timelin	ne	. 24
5.2 Remova	al and Disposal of Project Components	. 24
5.3 Restora	ation/Reclamation of Facility Site	. 25
Tables	5	
	reage of Soils with Selected Physical Characteristics	
	reage of Soils with Selected Classification Datareage of Soils in Selected Construction - Related Interpretations	

Exhibit

Exhibit 1:	Project 1	Location
P(XIIII) II I I I	Project	LOCATION

Exhibit 2: Land Control and Preliminary Development Area

Exhibit 3: **Preliminary Project Layout**

Exhibit 4: Configuration of Proposed Project Arrays

Surface Waters and Watersheds of Project Area Exhibit 5:

Exhibit 6: Project Area Prime Farmland

Appendices

Appendix A: Selected Soils Physical Features, Classifications, Interpretations, and Limitations

Appendix B: NRCS Soil Map for the Project

Appendix C: Grading Heat Map

1.0 Purpose and Applicability of Plan

The objective of this Agricultural Impact Mitigation Plan ("AIMP" or "Plan") is to identify measures Byron Solar, LLC ("Byron Solar" or "Applicant") and its employees and contractors will employ to avoid, correct, and/or mitigate potential adverse impacts to agricultural land resulting from the construction, operation, and decommissioning of the Byron Solar Project (Project, Project Site, Project Area). Byron Solar has acquired land control needed for the project (including leases, easements, and purchase agreements). Use of this land will change from agricultural production to solar photovoltaic electricity production during the life of the Project. This Plan outlines measures to ensure the land will be returned to future agricultural usages following the closure and decommissioning of the Project. This Plan also includes descriptions of best management practices (BMPs) that will be used during construction to minimize long-term adverse impacts to the soil. Byron Solar and the construction contractor (the Contractor) hired to build the facility will adhere to this Plan. It is anticipated that certain methods and practices may be identified by the Contractor that work better and more efficiently and thereby provide a higher degree of safety while constructing the Project.

Byron Solar will coordinate with the Minnesota Department of Commerce Energy Environmental Review and Analysis (EERA), the Minnesota Department of Agriculture (MDA), Minnesota of Natural Resources (MNDNR) and the Minnesota Board of Water and Soil Resources (BWSR) regarding development of the AIMP's contents and site-specific characteristics. In conjunction with these agencies, Byron Solar will work to adjust the AIMP and Vegetation Management Plan (VMP) as needed.

This Plan includes establishing a habitat with beneficial plant species and a potential grazing environment within the project perimeter fence. Native and non-invasive naturalized plant species will be selected that thrive in shade conditions and do not interfere with the operation of the solar panels yet provide benefits to the soil and pollinators species. Typically, a solar site has a shorter prairie mix within the solar arrays, a taller prairie mix in the open space between the fence and arrays, and a wetland seed mix for wetlands or areas anticipated to retain water. The seed mixes are formulated to be native or naturalized non-invasive plants and are developed with recommendations from plant specialists in coordination with the Minnesota Department of Natural Resources (MNDNR). The goal is to design seed mixes that will achieve the goals Byron Solar has for efficiently operating the solar facility, promote pollinator habitat, establish stable perennial ground cover, suppress weeds, reduce soil erosion and runoff, and improve water infiltration. Grazing may be implemented as a natural approach to weed management. It is being considered in areas where weed control or use of mechanical equipment may be limited. Seed mixes that are suitable for grazing may differ from a seed mix that is sourced to promote pollinator habitat.

Byron Solar will utilize an adaptive management approach for vegetation management. The VMP will be prepared in consultation with an experienced native plant community restoration company. They will work with Byron Solar to develop plans for maintenance of the site's plantings, potentially including forage plantings, throughout the life of the Project. More information on maintenance of the native plantings is outlined in the VMP.

This Plan is separated into several distinct sections: Section 2 provides an overview of the proposed Project and its components. Section 3 addresses limitations and suitability of the soils at the Project, Section 4 discusses the BMPs that will be used during construction and operation of the Project, and Section 5 outlines decommissioning.

2.0 Project Overview

2.1 Background

Byron Solar, LLC, a wholly owned subsidiary of EDF Renewables, Inc., (EDF Renewables) proposes to construct the Byron Solar Project on approximately 1,854 acres (Project Area) of land. The Solar Facility is located on 1,801 acres in Mantorville and Canisteo Townships, Dodge County and the HVTL is on 53 acres in Kalmar Township, Olmsted County and Mantorville Township, Dodge County (Exhibit 1 – Project Location) (the Project Area includes approximately 53 acres for a roughly 3-mile transmission line crossing over U.S. Highway 14, is also assessed for impacts in this document). The Solar Facility is located within Dodge County: Township 106N, Range 16W, Sections 2, 3, 10, 11, 12, 13, 14, and 15 and Township 107N, Range 16w, Section 35. The HVTL is located within Dodge County, 107N, Range 16 W, Sections 25, 35, and 36 and Olmsted County, Township 107N, Range 15W, and Section 31. Byron Solar anticipates that approximately 1,605 acres (Project Area) will be affected by Project facilities (Exhibit 2 – Land Control and Preliminary Development Areas). The solar project facilities will be considered the {Preliminary Development Area (1,553 acres) and the HVTL will be built in a corridor defined at the HVTL Project Area. The Project lies primarily south of US Highway 14, with the transmission line connecting the Project Substation to the Byron Substation. The Project will generate up to 200 megawatts (MW) and provide roughly 435,000 megawatt hours (MWh) annually of reliable, deliverable on-peak energy. The Project is to be placed in service by the end of 2024.

The Project will interconnect to the nearby Byron Substation via a 345kV High Voltage Transmission Line (HVTL). The substation is owned by the Southern Minnesota Municipal Power Agency (SMMPA). Byron Solar selected this site due to its proximity to existing and planned transmission facilities, available transmission capacity, excellent solar resource, existing road infrastructure, willing landowners, and the relatively flat, unobstructed terrain on the Project site. Additionally, in selecting the Project site, Byron Solar also concluded that its development will not result in significant environmental impacts.

The Project Site is on a nearly level to gently rolling landscape with elevations generally ranging from 1,224 to 1,310 feet above sea mean level. It is covered by fine-loamy and loamy soils used annually for corn and soybean production, which has remained for more than a century the dominant land use for the Project Area.

Byron Solar has entered into lease agreements with landowners for the parcels on which the solar panels would be constructed and land occupied by the 150-foot-wide transmission right-of-way will be under easement. Byron Solar would exercise its purchase options and hold title to areas with purchase options after the Site Permit is issued and prior to the start of construction. Project facilities shown in the Preliminary Project Layout (**Exhibit 3**) and Configuration of Project Components (**Exhibit 4**) were sited on land for which Byron Solar currently has either an easement or lease agreement. The current land interests under easement and lease are sufficient to accommodate the Project's facilities and setback requirements.

2.2 Project Components

The Project will include the following major components, systems and associated facilities:

- Solar modules, racking system, and inverters;
- Electrical collection system;
- Project substation;
- Operations and Maintenance (O&M) Facility;
- Access roads;
- Weather stations (up to 20 feet tall); and
- Perimeter fencing

Each of these components is described in more detail below.

2.2.1 Configuration of Solar Panels, Arrays, and Racking

The Project will convert sunlight into direct current (DC) electrical energy using photovoltaic (PV) cells combined within protected modules also known as solar panels. The DC electricity is converted to AC by inverters located throughout the arrays. The Project can be considered an aggregate of individual PV solar panels interconnected by electric conductor and equipment at increasing scales to ultimately deliver up to 200 MW of nameplate alternating current (AC) of electricity to the existing Byron Substation currently on the electrical grid and immediately adjacent to the Project. From smallest to largest scales, Project components are described below and presented on **Exhibits 3** and **4** (Preliminary Project Layout and Configuration of Project Components):

- 1. **Individual PV solar panels** are approximately 4 to 6.5 feet long by 2 to 3.5 feet wide by 2 inches thick and are installed on metal foundations that are driven or screwed into the ground.
- 2. **Lines** of interconnected PV panels consist of a line of short-edge butted panels with each line oriented to and rotating along a north-south single axis to optimally track the rotational movement of the earth. These lines represent the racking upon which the individual solar panels are mounted.
- 3. **Arrays are groups of line of** PV panels.
- 4. **Construction Units** consist of Arrays of PV panels delineated by their connectivity and relationship. The Project consists of:
 - a. A 102-acre (approximate) **Unit 1** bounded by US Highway 14 to the north and 270th Ave to the east;
 - b. A 184-acre (approximate) **Unit 2** bounded by 650th Street to the south;
 - c. A 330-acre (approximate) **Unit 3** bounded by 650th Street to the north and 655th Street to the south;
 - d. A 361-acre (approximate) **Unit 4** bounded by 655th Street to the north and Unit 5 to the east;
 - e. A 289-acre (approximate) **Unit 5** bounded by 655th Street to the north, 270th Street to the east, and Unit 4 to the west;
 - f. And a 474-acre (approximate) **Unit 6** bounded by 270th Street to the west, 120th Ave SW to the east, 660th to the north, and 670th Street to the south.

- 5. Approximately 182,000 linear feet of electrical collection system connect all units underground.
- 6. An overhead transmission line extending approximately 3 miles and connecting the Project substation to the nearby Byron substation.

Byron Solar will use a single axis tracking system where the lines of solar modules are rotated by motors to follow the sun throughout the day. The lines in north and south rows will face east in the morning, horizontal during mid-day, and then face west in the afternoon. Tracker motors will be used to rotate the lines of panels manually to the east or west as needed to facilitate maintenance access and vegetation management. Spacing between the panel edges when they are in a horizontal position is typically 13.3 feet and sufficient for maintenance vehicles. Separation of PV Panel lines will typically be 20 feet from the centerline between two adjacent lines turning axis.

2.2.2 Inverters, Transformers, and Electrical Collection System

Electrical wiring will connect the panels to inverters, which will convert the DC power to AC power. The AC power will be stepped up through a transformer from the inverter output voltage to 34.5 kilovolt (kV) and brought via the collection cables to the Project substation. The electrical collection system will be installed below-ground. The type of electrical system will be determined prior to construction based on technology, availability of materials, and costs.

2.2.2.1 Below-ground Electrical Collection System

Power inverters convert approximately 1,500 volts of DC power output from the PV solar panels to between 600-690 volts of AC power. A step-up transformer then converts the inverter AC voltage to an intermediate voltage of 34.5kV. The solar panels deliver DC power to the inverters through electric conductor cabling that will be routed via above-ground means and belowground trenches (typical trench depth is 4 feet, but in some cases shallower and trench widths of 2 to 4 feet may be used). Below-ground AC electric conductor collection lines will transfer the electricity from the inverter equipment (which is assembled on skids and delivered to the project) to the substation. During trench excavations, the topsoil and subsoil will be removed and stockpiled separately in accordance with Section 4.7 of this Plan. Once the electrical conductor cables are laid in the trench, the trench will be backfilled with subsoil followed by topsoil. Electrical collection technology is changing and will be site-specific depending on geotechnical analysis, constructability, and availability of materials. Final engineering and procurement recommendations will help determine the construction method for the electrical collection system.

For below-ground cabling, inverter skids will be placed at locations throughout the Project and will include two transformers to which the inverters will feed electricity. The final number of inverters for the Project will depend on the inverter size, inverter and module availability, as well as the final array configuration. Skids provide the steel foundation for the enclosed inverter, transformer, and Supervisory Control and Data Acquisition (SCADA) systems. The height of a skid is approximately 8-12 feet above grade. The skids will be placed atop a poured reinforced concrete slab or pier foundations and will typically measure 10 feet wide by 25 feet long. Concrete foundations will be poured onsite or precast and assembled off-site. The inverters

skids are located within the interior of the Project along access roads. The specific solar inverter to be used will be SMA Solar Technology 4200 UP-US inverters.

2.2.3 Project Substation and Operations and Maintenance Building

The Project will have an on-site step-up substation with metering and switching gear required to connect to the transmission electrical grid. The substation will be located within the Project Area north and west of Unit 1 as depicted in **Exhibits 2** and **4**. It will be designed according to regional utility practices, Midcontinent Independent Transmission System Operator Standards, Midwest Reliability Organization Standards, and National Electrical Safety Code. The area within the substation will be graveled to minimize vegetation growth in the area and reduce risk of fire. Secondary containment areas for the transformers will be installed as necessary. The gated and locked substation will be fenced with a 6 or 8-foot fence for security and safety purposes as described in Section 2.2.5. The substation's area will be approximately 160 feet x 175 feet once construction is complete. Final dimensions will depend on equipment selection, engineering and design specifications.

An operation and maintenance (O&M) facility for the project is currently planned on approximately 2.6 acres in the north central portion of the project just east of the substation (**Exhibit 3**). From this facility, the solar modules and other electrical systems equipment will be remotely monitored using a SCADA system, and vehicles, tools and maintenance equipment can be stored.

2.2.4 Access Roads

The Project will include approximately 22.6 miles of internal graveled access roads between the arrays, inverters substations and other infrastructure. The final length of the access roads will depend on the equipment selected and final engineering. These roads are approximately 12-16 feet wide along straight portions and wider along curves at internal road intersections (approximately 45 feet). There are ten access points to the Project from existing public roads: one access to construction Units 1-5, two to Unit 5, two to Unit 6, and one to the Project substation and O&M building. Access points were designed in areas with less traffic, efficient access, and to provide safe ingress and egress for emergency responders, visitors and employees. Entrances to the Byron Solar site will have locked gates. Byron Solar has optimized the amount of access points and roads within the Preliminary Development Area.

Upgrades or other modifications to the public roads may be required for construction entrances or operation of the Project. Byron Solar will work with Dodge and Olmsted Counties to facilitate public road upgrades that meet the required public standards. Byron Solar will continue to coordinate with County and State agencies as the Project develops. Driveway changes utilizing county roadways will require road use agreements, driveway permits, and utility crossing permits from Dodge and Olmsted Counties, which will be obtained prior to construction. If an entrance utilizing US Highway 14 would be used, it would require submittal of an application for access (driveway) permit from the Minnesota Department of Transportation.

2.2.5 Permanent Fencing

Security fencing will be installed along the project perimeter of each of the construction units' Preliminary Development Areas. Fencing will be secured to posts that will be directly embedded in the soil or set in concrete foundations as required for structural integrity. The fencing will consist of either a 6 or 8-foot chain link fence with a top guard angled out and upward at 45

degrees with 3-4 strands of smooth wire (no barbs), or an agricultural type fencing will be installed.

2.2.6 Stormwater Drainage Basins

Byron Solar has preliminarily designed 38 stormwater drainage basins throughout the Preliminary Development Area that have been engineered to meet standards for rate control and water quality. These basins are located in existing low areas that also contain hydric soils and for which the preliminary design for solar facilities has avoided. These areas will be vegetated with a wet seed mix that will help stabilize soils after rain events. Overall Project Site drainage patterns will not be significantly altered with solar development.

2.2.7 Transmission System

The Project will interconnect into the existing Byron Substation via a 345-kV overhead gen-tie transmission line. There will be a single dead-end structure within the Project substation and approximately 22 transmission structures between the Project and Byron substations with an overall length currently estimated to be approximately 3 miles, pending final engineering. The transmission structures will likely be made of wood and/or steel and will be 90 to 170 feet tall. The conductor to be used for the overhead 345 kV transmission line is two-bundled 795 kcmil 26/7 ACSR "Drake" with a single 48 fiber OPGW (DNO-10926) and an additional 3/8" EHS 7-strand steel OHGW for additional shielding. Per Minn. Stat. 216E.01 Subd. 4, the proposed transmission line is defined as a high voltage transmission line.

2.2.8 Temporary Facilities

Byron Solar will use one temporary laydown area within the Preliminary Development Area, totaling approximately 12 acres. The laydown area will serve both as a parking area for construction personnel and staging area for Project components during construction. The laydown area has been sited to avoid tree clearing. After construction, the area will be reseeded as described in the VMP.

2.3 Construction

2.3.1 Site Clearing & Vegetation Removal

Depending on timing of the start of construction, the Project may require the clearing of crop residue from farm fields. Alternatively, and depending on construction timing, Byron Solar may plant a cover crop in spring 2023/24 that is compatible with the VMP. This cover crop would stabilize soils if agricultural crops are not planted that year.

2.3.2 Earthwork

A grading heat map was created for the Project that shows earthwork areas and volumes (Appendix C). The majority of soil disturbances will occur during the first phase of Project construction when grading (generally limited to, building internal access roads, substation construction, and preparation for inverter skid locations) takes place. The Contractor may need to move soils in some areas to "flatten" parts of the site or, to complete minor grading of topsoil. Soil grading will involve removing and segregating the upper 12 inches of topsoil from the subsoil when construction grading or excavation take place; this will preserve topsoil so it can be placed back as the topsoil layer when construction is complete. The topsoil stockpile area(s)

would be near the location where it was removed, accurately located (GPS boundary, soil depth) and graded to facilitate long term preservation and revegetation. Subsoil would be removed and re-used as needed or to an acceptable pre-established and approved area for storage. As part of decommissioning, subsoil would be replaced first (as needed), followed by topsoil. The soil would be replaced and brought back to pre-construction contours to allow for farming. The earthwork activities will be completed using typical earthmoving construction equipment – scrapers, bulldozers, front-end loaders, excavators and skid-steers. BMPs that will be used during these earthmoving activities are described in detail in Section 4

2.3.3 Access Road Construction

As a component of earthwork, permanent entrances, access roads and turnouts will be constructed for the Project as indicated in **Exhibit 3**. This work would start with the stripping and segregating of topsoil materials from the proposed roads. The Contractor will then compact the subgrade materials typically 16 feet wide to the specified compaction requirements as laid out by the civil and geotechnical engineer plans. As specified, a geo-fabric may be used, depending on the soil type and location, a layer of 4 to 12 inches of gravel will be applied and compacted. The gravel will be placed level with the existing grade to facilitate drainage and minimize ponding. After the road surface is compacted, the Contractor will shape Project drainage ditches as designed on the grading plan.

Byron Solar has chosen flatter areas within the Project Area to support Project infrastructure thus minimizing the amount of topsoil that will need to be removed due to grading. Topsoil removed from permanent access roads will be stockpiled as described in Section 2.3.2 in suitable locations on-site to facilitate final reclamation during decommissioning.

2.3.4 Solar Array Construction

After grading activities are complete, the solar array racking system supports will be constructed using steel piling driven into the ground. In some situations, where soils are low strength or consist of loose, non-cohesive sand, helical screw or auger-type foundation posts may be used. Foundations typically use galvanized steel where high load bearing capacities are required. The piles are driven using a hydraulic ram, screw or pneumatic equipment that moves on tracks. This task requires two workers. Soil disturbance for this task would be negligible since the solar pile driver equipment does not excavate soil. The pile driving equipment is about the size of a small tractor. It is equipped with tracks to disperse its weight over a larger ground surface and reduce soil disturbance, rutting and compaction.

The remainder of the racking system will be installed by construction crews using hand tools and specialized equipment. Array racking and steel cross-members will be bolted to the foundation piling to create a "rack" to which the solar panels are fastened.

During array and racking assembly, multiple crews and various types of vehicles will be working within the Project Area. To the extent practicable, vehicular traffic will be limited to permanent and temporary access roads to minimize soil disturbance and compaction. Soil mixing will be avoided to the degree practicable. These vehicles will likely include flatbed trucks for transporting array components, small all-terrain vehicles, and pick-up trucks to transport equipment and workers. Panels will be staged in advance throughout the Project Area and will

be brought to specific work areas for installation by wagon-type trailers pulled by small tractors or all-terrain tracked equipment.

2.3.5 Electrical Collection System

The collection system will either be buried in a trench or conduit. Part of the underground collection system will be horizontally directionally drilled under roadways in approximately 10 locations. Final engineering and procurement will determine the detailed construction method that will be used. For the purposes of this Plan, Byron Solar provides construction methods and BMPs for trenching.

The electrical collection cabling will be installed using a trenching machine or excavator. The trencher will cut an exposed trench. Cabling will be installed to a minimum depth of 4 feet. The upper 12 inches of topsoil will be stripped from the trench and temporarily stockpiled using a small backhoe. After cables are installed, the trenches would be backfilled, first with subsoil removed. Stockpiled topsoil would then be replaced over the subsoil in sufficient quantities to ensure restoring the trench to the original grade after settling. BMPs that will be used during these earthmoving activities are described in detail in Section 4.

2.3.6 Inverter Installation

Inverter installation will begin with topsoil removal; it will be scraped and stockpiled at designated locations and graded to facilitate revegetation. Underground conduit and junction boxes will be installed throughout the Project to facilitate required cabling connecting equipment. The inverters units will then be placed on frost-footing supported concrete pads or on driven/helical screw pier foundations that will be designed to specifications necessary to meet the local geotechnical conditions. A truck with a flatbed trailer will deliver the premanufactured skids with an inverter, transformer and SCADA equipment to each inverter foundation. They will typically be set in place using a rough-terrain type hydraulic crane.

2.3.7 Project Substation Construction

Construction work within the proposed substation will begin by scraping and segregating topsoil and placing it in a designated location. Additional site preparation will include installation of substructures and electrical equipment. Installation of concrete foundations and embedments for equipment will require the use of trenching machines, concrete trucks, pumpers and vibrators, forklifts, boom trucks, and cranes. Above-ground and below-ground conduits from this equipment will run to a control enclosure that will house the protection, control, and automation relay equipment. Two station service transformers will be installed for primary AC power requirements. Batteries and battery chargers will be installed inside the enclosure providing power to the switchyard's control system. Crushed rock will be placed over the substation and adequate lighting will be installed around the substation for worker safety during construction and operation.

Substation foundations will typically be installed as follows: Method 1 would be to use a small rubber tire backhoe to excavate major foundations prior to pouring the concrete slabs. Method 2 would use an auger/drill type machine for minor foundations.

Using either method, the disturbance limit will be within the footprint of the substation for both the foundation equipment and the concrete delivery trucks. BMPs that will be used during these

earthmoving activities are described in Section 3. Soil disturbance for the substation area will be excavated and restored as described in Section 2.3.2.

2.3.8 Stormwater Drainage Basins

Similar to Project substation construction described above, drainage basins would have topsoil removed and temporarily stored in a pre-established suitable location. Subsoil would then be excavated to the design depths and slopes to accommodate inlets and outlets. Excavated subsoil would be distributed throughout the site as fill material in areas where grading is required. Topsoil would be replaced and the basins vegetated with a wet tolerant seed mix.

2.3.9 High Voltage Transmission Line Construction

Given the proximity of the Byron Substation and the proposed Project substation, a 345 kV gentie line of approximately 3 miles will be required. This includes approximately 22 wood or steel direct embedded structures.

2.3.10 Project Fencing Installation

A fencing company will be contracted to construct fencing, as described in Section 2.2.5, around the perimeter of the Project. Additional fencing around the substation will be installed. It will comply with the National Electric Code. Posts for fence around the Project substation will be spaced approximately 10 feet on center. Corner posts will be augured 3.5 feet and embedded in concrete for structural support. Tangent posts will be direct buried 3.5 feet similar to corner posts. The Site will have doors and gates installed, as needed.

3.0 Limitations and Suitability of Site Soils

Soil varies considerably in its physical and chemical characteristics that strongly influence the suitability and limitations that soil has for construction, reclamation, and restoration. Major soil properties include:

- Soil texture
- Drainage and wetness
- Presence of stones, rocks, and shallow bedrock
- Fertility and topsoil characteristics
- Soil slope

Interpretative limitations and hazards for construction and reclamation are based to a large degree on the dominant soil properties, and include:

- Prime farmland status
- · Hydric soil status
- Susceptibility to wind and water erosion
- Susceptibility to compaction
- Fertility and Plant Nutrition
- Drought susceptibility and revegetation potential

3.1 Land Use Considerations

Based on an aerial imagery and written history regarding the Project Area, nearly all of the Project Area has been in agricultural use for decades. The area was originally settled in the mid 1800's. Ninety percent of the soils in Dodge County are classified as prime farmland, prime farmland if drained, or prime farmland if protected. Sixty-one percent of the soils in Olmsted County are classified as prime farmland, prime farmland if drained, or prime farmland if protected. A large portion of Olmsted County is taken up by urban development. The few acres of the Project Area that are located within Olmsted County are occupied by approximately 0.5 mile of the transmission line and the line's right-of-way. Typically, high value crops such as corn and soybean rotations are grown in the area. The Project Area is located within the Zumbro River Watershed, as shown in **Exhibit 5**.

Byron Solar will maintain the existing subsurface and surface drainage systems during Project operation, with modifications limited to the extent required to avoid conflict with planned project features such as foundation piles and piers. Upon decommissioning, the land will be restored for agriculture uses. The subsurface drainage infrastructure will not be removed, preserving the general drainage characteristics of the land similar to the pre-construction condition.

3.2 Important Soil Characteristics

The Soil Survey Geographic Database (SSURGO) is the digitized county soil survey and provides a GIS database relating soil map unit polygons to component soil characteristics and interpretations. Soil map unit polygons in the SSURGO database were clipped to the Project and internal infrastructure boundaries, including the major pieces of infrastructure:

- Fenced area hosting solar panels, racks, and arrays
- Inverter locations
- HVTL
- Access roads
- Laydown area
- O&M facility
- Project substation

The acreage of major Project features sharing physical properties, classifications, and limitation interpretations important for construction, use, revegetation, and reclamation were determined by spatial queries of the GIS database. Soils within the Project Area not anticipated to be affected by construction or operations are indicated in the tables below. The following analysis only includes the 1,605 acres that will be affected by construction (Preliminary Development Area and HVTL Project Area) and the proposed laydown area.

A soil map of the Project Area is provided along with a table of selected characteristics of site soils including physical properties, classifications, and construction-related limitations in Appendices A and B.

3.2.1 Selected Physical Characteristics: Texture, Slope, Drainage and Wetness, Topsoil Depth, Bedrock and Presence of Stones and Rocks

There are approximately 1,854 acres within the Project Area. Selected physical characteristics of site soils are broken down by acreage within the 1,605-acre Preliminary Development Area and HVTL Project Area and the 248-acre undisturbed area in Table 1.

Soil texture affects water infiltration and percolation, drought tolerance, compaction, rutting, and revegetation among other things. Soil texture is described by the soil textural family, which indicates the range of soil particle sizes averaged for the whole soil. The soils within the Preliminary Development Area and HVTL Project Area (1,605 acres) are Fine Loamy (1,565 acres, 97.5 percent), Fine Silty (28 acres, 1.7 percent), and Fine Loamy over Sandy or Sandyskeletal (13 acres, 0.8 percent) textural families, indicating medium-textured soils dominated by soil particles in the loam and silt fractions with fewer particles in the clay and sand fractions. Medium-textured soils typically have good physical and available-water characteristics to support plant growth if not in excessively steep or wet conditions. They have high water-holding capacity, with most of the water being readily available for plant growth.

Slope affects constructability, water erosion, revegetation, compaction and rutting, among other properties. The soils (1,554 acres, 97 percent) within the Preliminary Development Area and HVTL Project Area are nearly level soils with representative slopes falling within the o-5 percent slope range. Approximately 3 percent (51 acres) of the soils have a slope within the 5-8 percent slope range.

Soil drainage indicates the wetness in the soil profile along with the speed at which internal water moves. Soil Drainage affects constructability, erosion by wind and water, and revegetation success. Most of the soils within the Preliminary Development Area and HVTL Project Area are in the Moderately Well Drained, Somewhat Poorly Drained, and Poorly Drained drainage classes (560, 452, and 438 acres, respectively) cumulatively 90 percent of the Preliminary Development Area and HVTL Project Area acreage, with smaller areas mapped into the Well Drained drainage class (156 acres, 1 percent). Soils in Somewhat Poor and Poor drainage classes are highly productive when drained and are frequently converted to agriculture after installation of subsurface drain tile. Moderately Well and Somewhat Poorly drained soils typically are not droughty or wet and are typically well suited to intensive agriculture.

Table 1: Acreage of Soils with Selected Physical Characteristics																			
		Total		Textural Family ²				Slope Range ³		Drainage Class ⁴						Topsoil Thickness ⁵			
	Project Feature		Fine	Fine- Loamy	Fine- Silty	Loamy	Coarse- Loamy	Fine-Loamy over Sandy or Sandy- skeletal /A	Slope 0- 5%	Slope >5- 8%	E	W	MW	SWP	Р	VP	0-12	>12-18	>18
										Acres									
		ı		1		Prelin	ninary Develo	pment Area and HVT	L Project A	rea (Potentia	Disturbanc	ee)	1	1					
	Access Road	152.7	0.0	150.05	1.42	0.00	0.00	1.23	145.63	7.08	0.00	15.02	46.14	47.25	44.31	0.00	47.66	42.30	62.75
	Collection Line	90.2	0.0	89.16	0.83	0.00	0.00	0.17	86.11	4.05	0.00	6.56	19.45	42.69	21.46	0.00	18.50	41.42	30.24
	Fenced Area	1271.2	0.0	1255.43	4.67	0.00	0.00	11.15	1232.40	38.85	0.00	118.71	479.12	331.42	342.00	0.00	466.04	288.45	516.76
ility	Inverter	0.2	0.0	0.23	0.00	0.00	0.00	0.00	0.22	0.01	0.00	0.02	0.08	0.07	0.06	0.00	0.09	0.05	0.09
Solar Facility	O&M Building	2.6	0.0	2.62	0.00	0.00	0.00	0.00	2.62	0.00	0.00	0.00	0.38	0.67	1.57	0.00	0.00	0.67	1.95
Sol	Stormwater Basin	16.6	0.0	16.51	0.06	0.00	0.00	0.00	16.21	0.36	0.00	0.52	0.86	2.70	12.49	0.00	1.96	2.13	12.49
	Substation	6.8	0.0	6.84	0.00	0.00	0.00	0.00	6.84	0.00	0.00	0.00	2.40	4.44	0.00	0.00	0.00	4.44	2.40
	Switchyard	0.0	0.0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	Laydown Yard	12.2	0.0	11.10	1.10	0.00	0.00	0.00	12.20	0.00	0.00	1.10	3.08	7.54	0.48	0.00	0.03	7.54	4.63
길	Transmission Line	17.4	0.0	10.85	6.57	0.00	0.00	0.00	17.08	0.34	0.00	4.41	2.63	5.04	5.33	0.00	0.00	10.44	6.98
HVTL	Transmission ROW	35.3	0.0	21.87	13.38	0.00	0.03	0.00	34.65	0.63	0.00	9.13	5.40	10.39	10.36	0.00	0.03	21.44	13.81
	Subtotal	1605.3	0.0	1564.6	28.0	0.0	0.0	12.6	1553.9	51.3	0.0	155.5	559.5	452.2	438.1	0.0	534.3	418.9	652.1
							Land Unde	er Control but Not Curi	ently Planne	d for Develop	ment	•	•	•					
	Undisturbed	248.4	0.00	244.75	3.57	0.00	0.00	0.09	238.76	9.66	0.00	29.08	48.78	74.17	96.39	0.00	63.52	62.81	122.09
								Grand	Total										
	TOTAL	1853.7	0.0	1809.4	31.6	0.0	0.0	12.6	1792.7	61.0	0.0	184.6	608.3	526.4	534.4	0.0	597.8	481.7	774.2

Total acres of Project features that are anticipated to be disturbed by supporting construction equipment traffic, excavation, and grading. Data obtained by merging Project facility polygons with the SSURGO spatial data in ArcGIS. Summations were performed in ArcGIS Pro or Microsoft Excel. The laydown area is included separately as it is a temporary facility.

² Data available directly from the Natural Resources Conservation Service (NRCS) SSURGO spatial or attribute database via geospatial query of the spatial or attribute data.

Representative slope values are taken directly from the SSURGO database. The SSURGO database provides representative slope values for all component soil series. Slope class grouping in percent that contains the representative slope value for a major component soil series. For example, a soil mapped in the 2-6% slope class has an average slope of 4% which is within the 0-5% slope range.

⁴ Drainage class as taken directly from the SSURGO database.

⁵ Topsoil thickness is the aggregate thickness of the A horizon described in the SSURGO database.

Depth to bedrock taken directly from the SSURGO database. Stony/Rocky soils are those soils that have either a cobbly, stony, boulder, shaly, very gravelly or extremely gravelly modifier to the textural class of the surface layer or that have a surface layer with >5% stones or rocks >3 inches in dimension.

Topsoil depth affects soil plant nutrition and surface soil structure. To maintain soil productivity, soils with thick topsoil will require larger areas for storage of larger volume of topsoil stripped from permanent infrastructure footprints such as permanent access roads, inverters, and the Project substation. Most of the soils within the Preliminary Development Area and HVTL Project Area are Mollisols and Alfisols and are characterized by the presence of relatively thick topsoil greater than 12 inches in depth (1,071 acres, 67 percent).

The presence of bedrock near the soil surface and rocks and stones in the soil profile affects constructability and revegetation. Few soils in the Preliminary Development Area are underlain by shallow bedrock. The bedrock was generally found to be deeper than 10 feet below grade with the exception of the very far southeast corner of the Project Area and a few other isolated locations. Additionally, cobbles and boulders were not observed in any of the soil boring completed as part of a geotechnical investigation completed in March 2021.

3.2.2 Selected Classification Data: Prime Farmland, Land Capability Classification, Hydric Soils.

Selected classification information for site soils are broken down by acreage within the 1,605-acre Preliminary Development Area and HVTL Project Area, 12-acre laydown area, and the 248-acre undisturbed area in Table 2.

Natural Resources Conservation Service (NRCS)-designated prime farmland soils have the best combination of physical and chemical characteristics for producing food, feed, forage, fiber, and oilseed crops and are also available for these uses¹. Of the soils in the Project Area, 96 percent are classified into prime farmland, prime farmland if drained, or prime farmland if protected. Within the Preliminary Development Area and HVTL Project Area, 94 percent of the soils are classified into prime farmland or prime farmland if drained.

Per Minnesota Rule 7850.4400, subpart 4, "no large electric power generating plant site may be permitted where the developed portion of the plant site... includes more than 0.5 acres of prime farmland per megawatt of net generating capacity." Minnesota's Department of Commerce came out with guidance stating what needs to be evaluated when a project is on more prime farmland than the rule allows. This includes describing why alternatives were not chosen, how avoidance of certain impacts influenced site selection, and prove that good faith consideration was given to nearby nonprime farmland areas.

Most of the soil in Dodge and Olmsted Counties is classified as prime farmland or prime farmland if drained, so siting came down to a location where other disturbances were minimized, and efficiency and ease of access could be maximized. Other sites could not be obtained closer to the Byron Substation due to competing lease agreements, municipal expansion areas, gas pipeline easements, and existing natural resource constraints such as the Zumbro River and Cascade Creek corridors. Sites further away would not minimize line loss and would have higher potential to negatively impact the natural environment. Additionally, moving

¹ [Prime farmland] has the combination of soil properties, growing season, and moisture supply needed to produce sustained high yields of crops in an economic manner if it is treated and managed according to acceptable farming methods. In general, prime farmland has an adequate and dependable water supply from precipitation or irrigation, a favorable temperature and growing season, an acceptable level of acidity or alkalinity, an acceptable content of salt or sodium, and few or no rocks. Its soils are permeable to water and air. Prime farmland is not excessively eroded or saturated with water for long periods of time, and it either does not flood frequently during the growing season or is protected from flooding.

further away would not have substantially changed the percentage of prime farmland required to site the Project. Byron Solar will utilize an adaptive management approach for vegetation management to provide the best care and protection for the prime farmland from year to year. Byron Solar is committed to ensuring the vitality of the soils during and after the project.

	Table 2: Acreage of Soils with Selected Classification Data													
Pı	Project Feature Total Prime Farmland								Hydric					
	J	Acres ¹	All Soils	Statewide Importance	If Drained	If Protected	Not Prime	1	2e	2w	3e	4e	5w	Soil ²
Preliminary Development Area and HVTL Project Area														
	Access Road	152.7	101.32	5.66	44.31	0.00	1.42	47.25	54.07	44.31	5.66	1.42	0.00	44.31
	Collection													
	Line	90.2	64.65	3.35	20.38	0.00	1.78	42.69	21.96	20.38	3.35	0.70	1.08	21.46
>	Fenced Area	1271.2	890.40	34.19	341.57	0.00	5.10	331.42	558.98	341.57	34.19	4.66	0.43	342.00
<u>i</u>	Inverter	0.2	0.16	0.01	0.06	0.00	0.00	0.07	0.10	0.06	0.01	0.00	0.00	0.06
Solar Facility	O&M Building	2.6	1.04	0.00	1.57	0.00	0.00	0.67	0.38	1.57	0.00	0.00	0.00	1.57
Sol	Stormwater Basin	16.6	3.72	0.30	12.45	0.00	0.09	2.70	1.03	12.45	0.30	0.06	0.03	12.49
	Substation	6.8	6.84	0.00	0.00	0.00	0.00	4.44	2.40	0.00	0.00	0.00	0.00	0.00
	Laydown Yard	12.2	11.72	0.00	0.48	0.00	0.00	7.54	4.18	0.48	0.00	0.00	0.00	0.48
TL	Transmission Line	17.4	11.02	0.34	5.33	0.73	0.00	5.10	6.65	5.33	0.34	0.00	0.00	5.33
HVTL	Transmission ROW	35.3	22.74	0.63	10.36	1.55	0.00	10.58	13.71	10.36	0.63	0.00	0.00	10.36
	Sub-total	1605.3	1079.2	43.8	425.7	0.7	8.4	434.3	645.6	425.7	43.8	6.8	1.5	427.2
		·			Under Contr	ol but Not Cui	rently Plann	ed for Deve	lopment					
	Undisturbed	248.4	142.37	8.05	86.04	0.00	11.96	74.17	68.21	86.04	8.05	1.60	10.35	96.39
						Grand								
	Grand Total	1853.7	1256.0	52.5	522.6	2.3	20.3	526.6	731.7	522.6	52.5	8.4	11.9	534.4

Total acres of Project features that are anticipated to be disturbed by supporting construction equipment traffic, excavation and grading. Data obtained by merging facility polygons with the SSUGO spatial data in ArcGIS. Summations were performed in ArcGIS Pro and Microsoft Excel.

Land Capability Class (LCC) is a system of grouping soils primarily on the basis of their capability to produce common cultivated crops and pasture plants without deteriorating over a long period of time. Soils within the Preliminary Development Area and HVTL Project Area are in LCC 1, 2e, 2w, 3e, 4e, and 5w. A numerical value of 1 and 2 indicates soils with no or few limitations that restrict the choice of plants or require very careful management. 1,506 acres or 95 percent of soils within the Preliminary Development Area and HVTL Project Area belong to LCC classes 1, 2e, and 2w. Soils in LCC classes 1 and 2e are typically considered prime farmland and soils in LCC class 2W are considered prime farmland if drained.

Hydric soils are generally described as soils in poorly drained to very poorly drained drainage classes. Hydric soils are a component of regulated wetlands and can be used to indicate areas that are potentially jurisdictional. Most of the soils are non-hydric (1,178 acres, 73 percent), with 427 acres (27 percent) being considered hydric soils.

Data available directly from the NRCSS SSURGO spatial or attribute databases via geospatial query of the spatial or attribute data.

3.2.3 Construction-Related Interpretations: Highly Erodible Land (Wind and Water), Compaction Prone, Rutting Prone, and Drought Susceptible with Poor Revegetation Potential.

Selected construction-related interpretative data for site soils are broken down in Table 3 by acreage within the 1,553-acre Preliminary Development Area, 53-acre HVTL Project Area, and the 248-acre undisturbed area.

Highly erodible land is identified as being susceptible to water and wind erosion. The majority of soils in the Preliminary Development Area are low relief, medium-textured soils with intermediate water infiltration characteristics that limit soil erosion by the agent of water. A small percentage, 0.4 percent (6.8 acres) of the Preliminary Development Area and HVTL Project Area soils are highly water erodible.

Wind erosion was evaluated using the wind erodibility group. Highly wind erodible soils are medium textured, relatively well drained soils with poor soil aggregation, resulting in soils with soil surfaces dominated by particles that can be dislodged and carried by the wind. None of the soils within the Preliminary Development Area are considered highly wind erodible.

Soils prone to compaction and rutting are subject to changes in soil porosity and structure as a result of mechanical deformation caused by equipment during construction. Compaction and rutting are related to moisture content and texture and are worse when medium- and fine-textured soils are subject to heavy equipment traffic when wet. Compaction is a concern for a small percentage (6.4 acres, 0.4%) of soils within the Preliminary Development Area and HVTL Project Area. Rutting susceptible soils cover all 1,553 and 53 acres (100 percent) if they are trafficked when wet.

Soils susceptible to drought include coarse textured soils in moderately well to excessive drainage classes. Revegetation during seed germination and early seedling growth is severely compromised during dry periods on droughty soils. None of the soils within the Preliminary Development Area are susceptible to drought.

Table 3: Acreage of Soils in Selected Construction - Related Interpretations											
]	Project Feature	Total Acres ¹	Hig	hly	Compact	R	utting Hazaı	Drought			
			Erod	ible ²	Prone ³				Susceptible ⁵		
			Water	Wind		Slight	Moderate	Severe			
					Acre	es					
		Preliminary Dev	velopment	Area an	d HVTL (Po	tential Dis	turbance)				
	Access Road	152.7	1.42	0.00	0.00	0.00	108.40	44.31	0.00		
	Collection Line	90.2	0.70	0.00	0.00	0.00	68.56	21.60	0.00		
>	Fenced Area	1271.2	4.66	0.00	0.00	0.00	929.24	342.01	0.00		
Solar Facility	Inverter	0.2	0.00	0.00	0.00	0.00	0.17	0.06	0.00		
ac	O&M Building	2.6	0.00	0.00	0.00	0.00	1.04	1.57	0.00		
ar I	Stormwater										
Sol	Basin	16.6	0.06	0.00	0.00	0.00	4.08	12.49	0.00		
01	Substation	6.8	0.00	0.00	0.00	0.00	6.84	0.00	0.00		
	Switchyard	0.0	0.00	0.00	0.00	0.00	0.00	0.00	0.00		
	Laydown Yard	12.2	0.00	0.00	0.00	0.00	10.62	1.58	0.00		
	Transmission										
HVTL	Line	17.4	0.00	0.00	2.16	0.00	12.09	5.33	0.00		
1	Transmission										
	ROW	35.3	0.00	0.00	4.27	0.00	24.92	10.36	0.00		
	Subtotal	1605.3	6.8	0.0	6.4	0.0	1166.0	439.3	0.0		
Land Under Control but Not Currently Planned for Development											
	Undisturbed		1.60	0.00	0.00	0.00	150.06	98.35	0.00		
				Grand	Total						
	Grand Total	1853.7	8.4	0.0	6.4	0.0	1316.0	537.7	0.0		

¹ Total acres of Project features that are anticipated to be disturbed by supporting construction equipment traffic, excavation and grading. Data obtained by merging facility polygons with the SSUGO spatial data in ArcGIS. Summations were performed in ArcGIS Pro and Microsoft Excel.

3.2.4 Summary of Major Soil Limitations at the Byron Solar Project

3.2.4.1 Prime Farmland

Soils within the Byron Solar Project Area are typically silt and clay loams suited for the existing agricultural production. Most of the site consists of flat to gently rolling hills which are used for agricultural production. Nearly all of the soils within the Project Area are prime farmland, or prime farmland when drained (**Exhibit 6**). The primary limitations for the soils during construction, operations and maintenance, and decommissioning include compaction and rutting that may occur when the soils are trafficked when wet, and the need to reserve and store large volumes of topsoil.

While soils classified as prime farmland will be impacted by the solar facility, Byron Solar will implement BMPs during construction detailed in Section 4.0 including soil segregation and decompaction, wet weather conditions, erosion and sediment control. After construction, and for the life of the Project, soils will be stabilized and soils given an opportunity to rest, as the site

Highly Erodible Water includes soils in Land Capability Cass 4e through 8e or that have a representative slope value greater than or equal to 9%. High Erodible Water includes soils in wind erodibility groups 1 and 2.

³ Includes soils that are somewhat poorly drained to very poorly drained soils in loamy sands and finer textural classes.

⁴ Rutting potential hazard based on the soil strength as indicated by engineering texture classification, drainage class, and slope. In general, soils on low slopes in wetter drainage classes, and compromised of sediments with low strength will have potential rutting hazards.

⁵ Includes soils with a surface texture of sandy loam or coarser that are moderately well to excessively drained.

is revegetated with a perennial cover of native and naturalized species according to seeding and management specifications agreed to between Byron Solar and the MNDNR. The establishment of a perennial plant community will improve soil health compared to the existing annual row crop agricultural practices; it will reduce runoff and erosion, increase soil organic matter and carbon sequestering. Upon decommissioning, the land could be returned to its pre-construction agricultural use or to another use if the economic conditions at that time indicated another use is an appropriate use for the site. Byron Solar anticipates that the property will be restored to agricultural use on decommissioning of the Project.

Byron Solar explored Dodge and Olmsted Counties for a solar project based on the good solar resource in this portion of the state and the positive experiences its parent company, EDF Renewables, had in developing a portfolio of 20 community solar gardens for Xcel Energy's Community Solar Garden Program. The majority of Dodge and Olmsted Counties is Prime Farmland, but other locations were avoided due to a greater potential for more significant environmental impacts. The location also provides good proximity to a substation and has willing landowners to sell or lease land for the Project.

Initial post-construction revegetation efforts and maintenance of vegetation during operations and maintenance will consider selecting suited plants, managing seeding times for late spring early summer when soil moisture is optimum for germination, and use of mulch and other BMPs. Existing tile drainage systems will be maintained, augmented, or replaced during Project operations. If an interruption occurs, it will be resolved by Byron Solar.

3.2.4.1 Topsoil Storage

Topsoil thickness across the site according to the geotechnical report is typically about 6 inches, is relatively high in organic matter, and fertile. Storing topsoil in large deep stockpiles is not recommended as deep piles of topsoil may not have the same biotic interaction of existing topsoil. It is recommended to have larger areas of shallower topsoil stockpiles. To the extent practicable, topsoil should be conserved by preselecting areas to receive excess topsoil from nearby areas, grading and seed bed preparation as appropriate, and revegetation to maintain a rhizosphere suitable for plant growth.

3.2.4.2 Compaction and Rutting

Compaction and rutting are potential limitations in the Project Area. Byron Solar will design construction access and manage construction passes to minimize the number of trips occurring on a given soil and will implement wet weather procedures when rutting is observed. Deep compaction is not anticipated to be a significant problem as the number of construction equipment passes over a given area is limited, and construction equipment consists of smaller, low-ground-pressure tracked vehicles. If compaction becomes an issue, decompaction of the soil by tilling or ripping may be performed if safely away from buried utilities.

4.0 BMPs During Construction and Operation

The Project will be constructed and operated on property owned or leased by Byron Solar. As stated above, the Project is located on productive farmland occupying a flat to gently rolling dense till in southeastern Minnesota.

Because construction activities will be limited to land owned or leased by Byron Solar, no direct impacts to adjacent land are expected. Additionally, the technology to be deployed at this facility

does not require that the entire Project Site be completely flat or a uniform grade. Because most of the Project site is currently nearly level or has slightly rolling terrain (Table 1), the amount of grading anticipated within the Preliminary Development Area is expected to be minimal and limited to roughly 0-2 feet of cut and/or fill. The PV arrays can be designed to follow the existing grade of the Project Site within certain tolerances, which allows the designer of the facility to minimize the amount of earthmoving activities that are required (see **Exhibit 3**).

While some grading activities will be required to raise or lower certain areas within the Project Site to facilitate placement of the solar modules, the majority of the Project Site's topography will remain within 0-2 feet of current elevations. The remainder of earthmoving activities would consist of work on the interior access roads, trenches for the DC and AC collection system, and foundational work for the Project substation and inverter skids, as necessary. The sections below describe the measures that the Contractor will implement to minimize the physical impacts to the integrity of the topsoil and topography of the Project Site.

Project Construction Phasing:

- 1. Identification of clearing and grading limits, sensitive areas, and wetlands prior to construction;
- 2. Installation of sediment and erosion controls as identified by project plans/approvals, including any necessary site-specific modifications as identified;
- 3. Performance of earthwork, drain tile adjustment, access road work, and initial stabilization of exposed soils;
- 4. Construction/installation of permanent stormwater treatment facilities;
- 5. Installation of the solar array and electrical components (concurrent with above);
- 6. Application of seed and temporary stabilization; and
- 7. Cleanup and permanent stabilization of the site.

4.1 Environmental Monitor

Byron Solar will contract with a third-party to monitor earthmoving and other activities during Project construction to ensure appropriate measures are taken to properly segregate and handle the topsoil. Byron Solar will coordinate with MDA to identify a suitable environmental monitor (Monitor). The Monitor will have a variety of duties, including but not limited to:

- Perform weekly inspections during the Project construction;
- Observe construction crews and activities to ensure that topsoil is being segregated and managed appropriately;
- For areas returning to agriculture after construction, monitor the site for areas of potential soil compaction and rutting (except within access roads) and make specific recommendations for decompaction;
- Make recommendations to the construction manager for Byron Solar;
- Assist in determining if weather events have created "wet weather" conditions and provide recommendations to the construction manager on stormwater BMPs; and
- Submit a report of adherence by Byron Solar to soil BMPs to MDA on a weekly basis during
 the major earthmoving phase of Project construction and upon completion of earthmoving
 activities.

Potential issues with BMPs will be reported to the Byron Solar construction manager and to MDA. The construction manager will use discretion to either correct the activity or stop work.

4.2 Soil Segregation and Decompaction

During construction, one of the primary means to protect and preserve the topsoil at the Project Site will be to separate the topsoil from the other subgrade/subsoil materials when earthmoving activities or excavation are taking place during grading, road construction, cable installation, foundation installation, etc. There may be limited situations where excavated subsoil must be stored on adjacent undisturbed topsoil. In these situations, subsoil will be returned to the excavation with as little disturbance of the underlying topsoil as practicable. Laying down a thin straw mulch layer as a buffer between the subsoil and topsoil may be used as practicable to facilitate more effective separation of the subsoil and underlying topsoil during the excavation backfill process.

Topsoil thickness is typically about 6 inches deep across the site according to the geotechnical report. This will be confirmed with additional soil tests prior to earthwork activities on the site. Byron Solar will identify the appropriate depth of topsoil that should be stripped and segregated from other subsoil materials during earthwork activities. This information will be provided with a recommendation on specific segregation methods/techniques to the Monitor for review and input.

As a preliminary recommendation, Byron Solar suggests that the full depth of topsoil be stripped between 6 and 12 inches in thickness in areas of construction grading. Topsoil greater than 12 inches from the soil surface would be treated similarly to the underlying subsoil. During the activities that require temporary excavations and backfilling (i.e., trenching activities) the subgrade material will be replaced into the excavations first and compacted as necessary, followed by replacement of topsoil to the approximate locations from which it was removed. Topsoil will then be graded to the approximate pre-construction contour. Byron Solar will strive to avoid compaction in other areas where it is not required by the design.

Following earthwork activities that require segregation of topsoil/subsoil, topsoil materials will be re-spread on top of the backfilled and disturbed areas to maintain the overall integrity and character of the pre-construction farmland. Excess topsoil material would be re-spread on the Project Site at pre-established locations on the site. The location and amount of topsoil will be documented to facilitate re-spreading of topsoil after decommissioning. This practice is described in more detail below for each of the earthmoving activities that are anticipated for this Project.

4.3 Wet Weather Conditions

During the construction of the Project, when periods of wet weather arise, a temporary halt of construction activities may be called if adverse impacts to soil occur. The Construction Manager for Byron Solar will have responsibility for halting activities if weather conditions pose a risk to worker safety, or if conditions are such that heavy equipment would cause significant soil compaction or rutting of the Project Site.

Following initial grading at the Site, many activities could still proceed in wet weather given the lack of heavy equipment required for those tasks. However, the Construction Manager for Byron Solar would be responsible for ensuring that topsoil erosion, rutting, compaction, or damage to

drain tiles (as present) is avoided to the extent possible. The Construction Manager will ensure that proper techniques and practices are used to loosen soil appropriately when encountered. Soil loosening with chisel plows prior to disking and planting will typically be a standard method of soil preparation in areas proposed for seeding. Agricultural equipment capable of operating within the approximate 20-foot wide space between panel lines when panels are oriented vertically would be used to loosen soil, prepare a seedbed, and plant suited seed mixes.

4.4 Adaptive Management During Construction

As with all forms of adaptive management, during construction of the Project changes may be made to the Plan should unforeseeable conditions arise that render the Plan unworkable. Using this approach will allow the Project to continue despite potential barriers. Should weather or site conditions during construction require different BMPs than those that are described in this section, Byron Solar will work with the Monitor, MDA and other appropriate agencies to discuss and select potential new approaches to the specific conditions that are encountered.

Byron Solar will remain flexible and implement new practices/procedures that will help ensure the quality of the land while maintaining the safety of the workers.

4.5 Initial Grading/Road Construction/Array Construction

The first phase of Project construction will be the general civil works at the Project Site where major cut and fill activities will be performed by the Contractor. Byron Solar will identify the appropriate depth of topsoil up to 12 inches that should be stripped and segregated from other materials during initial grading activities. Based on soil information, topsoil in this region of Minnesota may reach depths of 3 feet. This will be confirmed with tests prior to grading activities. If needed, Byron Solar will provide this information and a recommendation on specific segregation methods/techniques to the MDA for review and input.

The Contractor will first strip topsoil that sits higher than other areas. This will ensure that the topography falls within the tolerances allowed for by the solar array design. Based on preliminary design, engineering expects approximately 937 acres to require grading. During this civil work, topsoil will be pushed outside of the cut/fill areas and collected into designated spots for later use. Once topsoil is removed from the cut/fill areas, the sub-grade materials will be removed as required from on-site hills and relocated to on-site low spots. Prior to relocating subgrade materials to the low spots, topsoil in the low areas will be stripped and set aside before the fill is added, then re-spread over the new fill. The sub-grade materials would be compacted in place. When compaction is complete, the topsoil spoil piles will be re-spread over the reconditioned sub-grade areas.

This newly spread topsoil will be loosely compacted and/or "tracked" and employ the wind and stormwater erosion prevention BMPs.

After the majority of the major earthwork activities have been completed, the Contractor will start construction of the internal road network. This work would start with the stripping of topsoil materials from the roadbeds to a depth of up to 12 inches. Topsoil will be windrowed to the edges of each roadbed. Windrowing will consist of pushing materials into rows of stockpiles adjacent to the road which will be loosely compacted and/or "tracked" with stormwater and wind erosion BMPs in place. The Contractor will then compact the sub-grade materials. After

gravel is installed and compacted to engineers' requirements, the Contractor will shape Project drainage ditches as identified on the final grading plan. Previously stripped and windrowed topsoil will be re-spread throughout the Preliminary Development Area.

Following grading and road construction, the Contractor will begin the installation of foundation piles for the solar PV array racking system. This work will consist of directly driving the pile into the soil with pile driving equipment. These vehicles would operate on the existing surface of the ground and impacts would be limited and similar to a vehicle driving over the soil surface. Very little soil disturbance is expected from this activity.

4.6 Foundations

The Contractor will perform foundation work for the Project substation and inverters. For the substation, the Contractor will strip topsoil off the substation area, install the pier-type foundations, compact sub-grade materials, re-grade spoils around the substation yard, and then install clean rock on the surface. Topsoil stripped from the substation area will be pushed outside of the substation area and collected into designated locations for later use. These topsoil piles will be windrowed or piled and loosely compacted and/or "tracked" with stormwater and wind erosion BMPs in place. Once substation construction is advanced, the topsoil piles would be distributed in a thin layer adjacent to the substation area.

Where inverters are installed, topsoil will be stripped and placed adjacent to the inverter. The inverter foundations will then be excavated using an excavator followed by installation of rebar and concrete. After the concrete cures and its testing strength is completed, the subgrade soils will be compacted around the inverters. After the inverter are set, the adjacent topsoil will be respread around the inverter.

4.7 Trenching

Construction of the Project may require trenching for the underground installation of both DC and AC collection lines. If the collection lines are buried, the Contractor will be installing AC and DC collection cables in trenches of approximately 4 feet deep using the "open trench" method. Topsoil and subgrade materials would be excavated from the trench using typical excavating equipment or backhoes and segregated as described above. The bottom of each trench may be lined with clean fill or imported bedding to surround the cables. Byron Solar anticipates that native subsoil will be free of rocks greater than 3 inches. After cables have been installed on top of fill or bedding materials in the trench, 1 foot of screened, native backfill subsoil will be placed on the cables followed by additional 2 feet of unscreened native backfill trench spoil. This material would be compacted as necessary. The last 1 foot of each trench will then be backfilled with topsoil to return the surface to its finished grade after settling.

4.8 Temporary Erosion and Sediment Control

By adhering to a site-specific Stormwater Pollution Prevention Plan (SWPPP) required under the National Pollutant Discharge Elimination System (NPDES) permitting requirement that will be administered by the Minnesota Pollution Control Agency, Byron Solar will minimize the risk of excessive soil erosion on lands disturbed by construction.

Prior to construction, Byron Solar will work with engineers or the Contractor to outline the reasonable methods for erosion control and prepare the SWPPP.

These measures would primarily include silt fencing on the downside of hills, near waterways, and near drain tile inlets. This silt fencing would control sediment transport from stormwater. Check dams and straw waddles will also be used to slow water during rain events in areas that have the potential for high volume flow. In addition, the Contractor can use erosion control blankets on steep slopes, although given the site topography, this BMP will not likely be required. Lastly, as outlined above, topsoil and sub-grade material will be piled and loosely compacted and / or "tracked" while stored. The BMPs employed to mitigate wind and stormwater erosion on these soil stockpiles will include installing silt fence on the downward side of the piles as needed and installation of straw waddles if these spoil piles are located near waterways.

The SWPPP will identify designated onsite SWPPP inspectors to be employed by the Contractor for routine inspections as well as for inspections after storm events per the plan outlined in the SWPPP.

4.9 Drain Tile Identification, Avoidance and Repair

Byron Solar is aware of the presence of drain tile within the Project Area, which appears to be adequately draining the Project Area and discharging off site primarily into the county managed ditches. To minimize unforeseen repairs or damages to existing drain tile lines and/or drain tile systems, Byron Solar is committed to preserve soil drainage conditions as it currently exists; drain tile lines and drainage systems will be maintained, repaired or replaced by Byron Solar as needed.

4.9.1 Pre-Construction Tile Mapping and Repair

Pre-construction farm field drain tile mapping challenges often exist on solar energy projects. Identifying and locating drain tiles is complicated because of missing, incomplete, and inaccurate mapping. Byron Solar will review available drain tile maps from participating landowners in the Project associated with the Project Area. Byron Solar will attempt to avoid and/or relocate existing drainage systems as needed for construction of the Project.

Drain tile or drainage system adversely affected by Byron Solar will be identified, repaired, relocated, or replaced as needed to achieve the function and scope to its original size and capacity. Replacement or rerouting of tile will take place during construction or as it is identified in order to maintain the integrity of the drainage lines. This practice should minimize interruption of drainage on site or on neighboring farms that may drain through the Project leased property. New or modified drain tile systems installed by Byron Solar will be located using GPS equipment and archived in Project construction files and the Project Decommissioning Plan.

The following considerations will also apply:

- Tiles will be repaired with materials of the same or better quality as that which was damaged.
- Tile repairs will be conducted and located in a manner consistent with industry-accepted methods
- Before completing permanent tile repairs, tiles will be examined within the work area to check for tile that might have been damaged by construction equipment. If tiles are found to be damaged they will be repaired.

• Byron Solar will make efforts to complete permanent tile repairs within a reasonable timeframe, taking into account weather and soil conditions.

4.9.2 Project Design Considerations

Byron Solar's engineers will attempt to design around the tiles to ensure placement of solar racking systems does not damage the tile to the extent feasible. In some areas, re-routing of the tile is necessary and this re-routing work will take place immediately prior to or during construction.

4.9.3 Construction Measures

In areas where it will be impossible to design solar arrays around tile locations, steps will be taken to ensure the integrity of the drainage system will remain intact both during and after construction. Tile lines that are in direct conflict with solar array installation or trenches (i.e., collection lines) will be rerouted around the conflict area. Tile lines that have the potential to be damaged by construction traffic will be bridged or reinforced to maintain integrity.

4.9.4 Operational Measures

Following completion of construction, Byron Solar will inspect the Project Site after significant snow melt or rainfall events for evidence that tile systems are functioning adequately. If localized wet areas or standing water are observed, it is likely the tile system is not operating as anticipated. In this situation, the Tile Contractor will be reengaged to pin-point damaged tile that may have been missed during construction. Tile would be repaired following the process outlines above.

4.10 Construction Debris

Construction-related debris and unused material will be removed by Byron Solar and the Contractor. Below-grade, unusable materials will be removed and loaded immediately onto trucks for subsequent disposal at a designated off-site location. The Contractor will use locally sourced dumpsters and removal services to regularly check and schedule pick-ups for full dumpsters which will be switched out for empty ones. To the extent practicable, recyclable materials (i.e., cardboard) will be sorted and recycled at a local facility.

Debris/trash collection points and dumpsters will be located both in the laydown yards as well as at strategically designated locations close to where actual work is being performed. If loose debris fails to be deposited into dumpsters or if it becomes wind-blown, the Contractor will inspect and clear fence lines of debris on a daily basis to ensure that debris and trash does not leave the Project Area. Contaminated materials are not expected; however, if such materials are encountered during construction, specialized dumpsters and handling instructions will be employed to suit the types of contaminated materials discovered. Contaminated materials will be disposed of at the nearest appropriate facility in accordance with applicable laws, ordinances, regulations, and standards.

5.0 Decommissioning

At the end of the Project's useful life, Byron Solar will either take necessary steps to continue operation of the Project (such as re-permitting and retrofitting) or will decommission the

Project and remove facilities. Decommissioning, detailed in the Byron Solar Decommissioning Plan, will include:

- Removing the solar arrays, transformers, electrical collection system, fencing, lighting, and substations, and possibly the O&M building (depends on whether the O&M building is on site/is being used for other purposes);
- Removal of below-ground electrical cables to prescribed depths (cables buried below prescribed depth will be left in place);
- Removal of buildings and ancillary equipment to a prescribed depth;
- Removal of surface road material and restoration of the roads to substantially the same physical condition that existed immediately before construction. If the Project is decommissioned, Byron Solar would retain access roads the landowner requested be retained;
- Grading, adding or re-spreading topsoil, and reseeding according to the NRCS technical guide recommendations and other agency recommendations, areas disturbed by the construction of the facility or decommissioning activities, grading and soil disturbance activities will be kept to the minimum necessary to restore areas where topsoil was stripped in construction, topsoil in decommissioned roads and compaction only in areas that were compacted during decommissioning activities so that the benefits to the soil that were achieved over the life of the Project are not counteracted by decommissioning; and
- Standard decommissioning practices would be utilized, including dismantling and repurposing, salvaging/recycling, or disposing of the solar energy improvements, and restoration.

5.1 Timeline

Decommissioning is estimated to take 9 months to complete and the decommissioning crew will ensure that equipment is recycled or disposed of properly.

5.2 Removal and Disposal of Project Components

The removal and disposal details of the Project components are found below:

- Panels: Panels inspected for physical damage, tested for functionality, and removed from
 racking. Functioning panels packed and stored for reuse or resale (functioning panels may
 produce power for another 25 years or more). Non-functioning panels packaged and sent
 to the manufacturer or a third party for recycling or another appropriate disposal method.
- Racking: Racking uninstalled, sorted, and sent to metal recycling facility or reused.
- **Poles**: Poles will be dismantled/removed and will be sent to a metal recycling facility. Holes will be backfilled.
- **Wire**: below-ground wire will be removed to a depth of four feet as specified in the lease agreements. Facilities deeper than 48 inches may remain in place to limit vegetation and surface disturbance. Overhead lines will be removed from the Project and taken to a recycling facility.
- **Conduit**: Above-ground conduit will be disassembled onsite and sent to recycling facility.
- Junction boxes, combiner boxes, external disconnect boxes, etc.: Sent to electronics recycler.
- **Inverter/Transformer**: Evaluate remaining operation life and resell or send to manufacturer and/or electronics recycler.

- Equipment Foundation and Ancillary Foundations: The ancillary foundation for Byron Solar are pile foundations for both equipment skids and met stations. As with the solar array steel foundation posts, the foundation piles will be pulled out completely. Duct banks will be excavated to a depth of at least 48 inches.
- **Fence**: Fence and metal posts will be sent to metal recycling facility and wooden posts, if used, will be properly disposed.
- **Computers, monitors, hard drives, and other components**: Sent to electronics recycler. Functioning parts can be reused.

5.3 Restoration/Reclamation of Facility Site


After equipment is removed, the facility could be restored to an agricultural use, in accordance with the AIMP or to another use if the economic conditions at that time indicate another use is appropriate for the site. Holes created by fence poles, concrete pads, re-claimed access road corridors and other equipment, as well as trenches/drains excavated by the Project, will be filled in with soil to existing conditions and seeded. All unexcavated areas compacted by equipment used in decommissioning will be de-compacted in a manner to adequately restore the topsoil and sub-grade material to a density similar to the surrounding soils.

Grading and other soil disturbance activities during decommissioning will be kept to the minimum necessary to effectively decommission the site to maintain the soil benefits realized during the long-term operation of the Project, such benefits include building topsoil through plant matter decay, carbon capture, and beneficial soil bacteria that are often absent from soil subject to row crop agriculture. This will include the revegetation in accordance with the details of the VMP. In accordance with the SWPPP, erosion and sediment control measures will be left in place, as needed, until the Project site is stabilized.

Byron Solar reserves the right to extend operations instead of decommissioning at the end of the site permit term. In this case, a decision may be made on whether to continue operation with existing equipment or to retrofit the facilities with upgrades based on newer technologies. If the decision is made to continue operations, the Project will be re-permitted.

Exhibits

Byron Solar ProjectDodge and Olmsted
Counties, Minnesota



N:\0028109.00\GIS\ArcPro\Byron Solar AIMP\Byron Solar AIMP aprx Byron_AIMP_Ex01_ProjectLocation_ - Ex01_ProjectLocation | 5/5/2021 12:45 PM

N:0028109.00iGIS/ArcProlByron Solar AIMPIByron Solar AIMP aprx
Byron AIMP Ex02 LandControlDevelopmentAreas - Ex02 LandControlDevelopmentAreas | 5/5/2021 12:54 |

© 2021 Westwood Professional Services, Inc

N:\0028109.00\GIS\ArcProByron Solar AIMP\Byron Solar AIMP aprx
Byron_AIMP_Ex03_PreliminaryProjectLayout | 5/18/2021 1:31 PM

Legend

Project Area Boundary



O&M Building



Proposed Project Array Units Unit 1 Unit 4 Unit 2

Configuration of Proposed **Project Arrays**

© 2021 Westwood Professional Services, Inc.

(952) 937-5150 (952) 937-5822 (888) 937-5150

wood Professional Services, Inc.

Project Substation

Existing

Substation

Municipal Boundary

Unit 3

Unit 5 Unit 6 **EXHIBIT 4**

AIMP\Byron Solar AIMP.aprx =x8_FarmlandClassification | 5/5/2021 2:31 PM

(952) 937-5150 (952) 937-5822 (888) 937-5150 Westwood Professional Services, Inc.

County Boundary

Prime farmland if protected from flooding or not frequently flooded during the growing season (0.1%)

Not prime farmland (1.1%)

EXHIBIT 6

Appendix A

Selected Soils Physical Features, Classifications, Interpretations, and Limitations

Byron Solar ProjectDodge and Olmsted Counties, Minnesota



	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit			;	Selected Soil Physic	al Features		Se	lected Soil Class	ifications			/Reclamation and Limitatio	Interpretations ons
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³	Hydric Soil Rating ³	Highly Erodible Water ⁷	Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹
Access Road	5.19	M517A	Clyde silty clay loam, 0 to 3 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Access Road	0.01	M517A	Clyde silty clay loam, 0 to 3 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Access Road	14.90	M518B	Clyde-Floyd complex, 1 to 4 percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
7 iccess itoud	11.50	1413 TOB	Kasson silt loam, 2 to 6 percent	inic rounty	2.00	Moderately well	23	Time farmand it dramed	2 **	103	110	110	110	Severe	110
Access Road	27.70	M506B	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Mantorville loam, 6 to 12 percent	fine-loamy over sandy or				Farmland of statewide							
Access Road	1.23	M509C2	slopes, moderately eroded	sandy-skeletal	9.00	Well drained	15	importance	3e	No	No	No	No	Moderate	No
Access Road	18.44	M507A	Marquis silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Moderately well drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
/ ICCCS Roau	10.44	1 V1 JU/A	Nasset-Winneshiek complex, 12 to	inic-toailly	2.00	diamed	17	7 m areas are prime farimand		110	110	110	110	iviouciate	110
			18 percent slopes, moderately												
Access Road	1.42	M527D2	eroded	fine-silty	15.00	Well drained	6	Not prime farmland	4e	No	Yes	No	No	Moderate	No
A D 1	(17	N 4500 A	Oran silt loam, 1 to 4 percent	<u>ش</u> 1	2.00	Somewhat poorly	0		1	N	N	\ \ \.\.	N.	M 1 /	N
Access Road	6.17	M508A	slopes Readlyn silt loam, 1 to 3 percent	fine-loamy	3.00	drained Somewhat poorly	8	All areas are prime farmland	1	No	No	No	No	Moderate	No
Access Road	41.07	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Tripoli silty clay loam, 0 to 2	,				1							
Access Road	24.21	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
A D 1	7.02	14526D	Winneshiek silt loam, 2 to 6	<u>ر</u> 1	4.00	337 11 1 ' 1	7		2	N	N	N.	N.	M 1 /	N
Access Road	7.93	M526B	percent slopes	fine-loamy	4.00	Well drained	/	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Winneshiek silt loam, 6 to 12					Farmland of statewide							
Access Road	4.43	M526C2	percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	importance	3e	No	No	No	No	Moderate	No
			Barremills silt loam, drainageway, 1 to 5 percent slopes, occasionally												
Collection Line	0.13	N578B	flooded	fine-silty	3.00	Well drained	27	All areas are prime farmland	2e	No	No	No	No	Severe	No
Collection I in	0.16	M523C2	Bassett-Kasson complex, 6 to 12	fina laan	8.00	Moderately well drained	7	Farmland of statewide	3e	No	No	No	No	Moderate	No
Collection Line	0.16	IVI323C2	percent slopes, eroded Clyde silty clay loam, 0 to 3	fine-loamy	8.00	urainea	/	importance	je se	INO	INO	INO	INO	ivioderate	INO
Collection Line	2.71	M517A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
			Clyde-Floyd complex, 1 to 4	·		-									
Collection Line	5.60	M518B	percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Collection Line	1.08	1027A	Coland-Spillville complex, 0 to 2 percent slopes, flooded	fine-loamy	1.00	Poorly drained	32	Not prime farmland	5,,,,	Vac	No	N _c	No	Carrana	No
Collection Line	1.08	102/A	Kasson silt loam, 2 to 6 percent	ime-ioamy	1.00	Moderately well	32	inoi prime farmiand	5w	Yes	No	No	100	Severe	190
Collection Line	10.64	M506B	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Mantorville loam, 6 to 12 percent	fine-loamy over sandy or				Farmland of statewide							
Collection Line	0.17	M509C2	slopes, moderately eroded	sandy-skeletal	9.00	Well drained	15	importance	3e	No	No	No	No	Moderate	No
			Marquis silt loam, 1 to 3 percent	•		Moderately well		•							
Collection Line	8.65	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Nasset-Winneshiek complex, 12 to 18 percent slopes, moderately												
Collection Line	0.70	M527D2	eroded	fine-silty	15.00	Well drained	6	Not prime farmland	4e	No	Yes	No	No	Moderate	No
	0.,0		Oran silt loam, 1 to 4 percent		12.00	Somewhat poorly	, ,	F 		- 1.0			- 10		- 1.0
Collection Line	1.44	M508A	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	1	No	No	No	No	Moderate	No

	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit			;	Selected Soil Physic	al Features		Se	elected Soil Class	ifications			/Reclamation and Limitatio	Interpretations ons
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³	Hydric Soil Rating ³	Highly Erodible Water ⁷	Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹
Collection Line	41.25	M511A	Readlyn silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Somewhat poorly drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Collection Line	12.07	M515A	Tripoli silty clay loam, 0 to 2 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Collection Line	2.53	M526B	Winneshiek silt loam, 2 to 6 percent slopes	fine-loamy	4.00	Well drained	7	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Collection Line	3.03	M526C2	Winneshiek silt loam, 6 to 12 percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Fenced Area	0.01	N578B	Barremills silt loam, drainageway, 1 to 5 percent slopes, occasionally flooded	fine-silty	3.00	Well drained	27	All areas are prime farmland	2e	No	No	No	No	Severe	No
Fenced Area	55.51	M517A	Clyde silty clay loam, 0 to 3 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Fenced Area	107.13	M518B	Clyde-Floyd complex, 1 to 4 percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Fenced Area	0.43	1027A	Coland-Spillville complex, 0 to 2 percent slopes, flooded	fine-loamy	1.00	,	32	Not prime farmland	5w	Yes	No	No	No	Severe	No
Fenced Area	304.36	M506B	Kasson silt loam, 2 to 6 percent slopes Mantorville loam, 2 to 6 percent	fine-loamy	3.00	Moderately well drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Fenced Area	2.09	M509B	slopes	fine-loamy over sandy or sandy-skeletal	4.00	Well drained	15	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Fenced Area	9.06	M509C2	Mantorville loam, 6 to 12 percent slopes, moderately eroded	fine-loamy over sandy or sandy-skeletal	9.00	Well drained	15	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Fenced Area	174.75	M507A	Marquis silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Moderately well drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Fenced Area	4.66	M527D2	Nasset-Winneshiek complex, 12 to 18 percent slopes, moderately eroded	fine-silty	15.00	Well drained	6	Not prime farmland	4e	No	Yes	No	No	Moderate	No
Fenced Area	54.12	M508A	Oran silt loam, 1 to 4 percent slopes	fine-loamy	3.00	Somewhat poorly drained	8	All areas are prime farmland	1	No	No	No	No	Moderate	No
Fenced Area	277.30	M511A	Readlyn silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Somewhat poorly drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Fenced Area	178.92	M515A	Tripoli silty clay loam, 0 to 2 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Fenced Area	77.76	M526B	Winneshiek silt loam, 2 to 6 percent slopes	fine-loamy	4.00	Well drained	7	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Fenced Area	25.13	M526C2	Winneshiek silt loam, 6 to 12 percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Inverter	0.01	M517A	Clyde silty clay loam, 0 to 3 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Inverter	0.02	M518B	Clyde-Floyd complex, 1 to 4 percent slopes	fine-loamy	2.00		23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Inverter	0.06	M506B	Kasson silt loam, 2 to 6 percent slopes	fine-loamy	3.00	Moderately well drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Inverter	0.00	M509C2	Mantorville loam, 6 to 12 percent slopes, moderately eroded	fine-loamy over sandy or sandy-skeletal	9.00	Well drained	15	Farmland of statewide importance	3e	No	No	No	No	Moderate	No

	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit			\$	Selected Soil Physic	al Features		Se	elected Soil Class	ifications			/Reclamation and Limitatio	Interpretations ons
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³	Hydric Soil Rating ³	Highly Erodible Water ⁷	Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹
			Marquis silt loam, 1 to 3 percent			Moderately well									
Inverter	0.03	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Oran silt loam, 1 to 4 percent			Somewhat poorly									
Inverter	0.01	M508A	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Readlyn silt loam, 1 to 3 percent			Somewhat poorly									
Inverter	0.05	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Tripoli silty clay loam, 0 to 2						_					_	
Inverter	0.03	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
		3.650.65	Winneshiek silt loam, 2 to 6	or 1			_							l	
Inverter	0.02	M526B	percent slopes	fine-loamy	4.00	Well drained	7	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			W. 11.1 11.1 6. 12												
	0.00	1.550.660	Winneshiek silt loam, 6 to 12	or 1	0.00	*********	_	Farmland of statewide	_	3.7	3.7	3.7	3.7		3.7
Inverter	0.00	M526C2	percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	importance	3e	No	No	No	No	Moderate	No
			Barremills silt loam, drainageway,												
7 1 37 1	1 10	N.570D	1 to 5 percent slopes, occasionally	C 11	2.00	337 11 1 1 1	27		2	NT.	NT.	NT.	N T	C	N.
Laydown Yard	1.10	N578B	flooded	fine-silty	3.00	Well drained	27	All areas are prime farmland	2e	No	No	No	No	Severe	No
I 1 V 1	0.02	M50(D	Kasson silt loam, 2 to 6 percent	£ 1	2 00	Moderately well	0	A 11	2-	NI-	NI-	NI-	NI.	Madausta	N.
Laydown Yard	0.03	M506B	slopes Marquis silt loam, 1 to 3 percent	fine-loamy	3.00	drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
I 1 V 1	2.06	M507A	-	£ 1	2.00	Moderately well drained	19	A 11	2-	NI.	NI-	NI-	NI.	Madausta	N.
Laydown Yard	3.06	M507A	slopes Readlyn silt loam, 1 to 3 percent	fine-loamy	2.00	Somewhat poorly	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Laydown Yard	7.54	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Laydowii Taid	7.54	WIJIIA	Tripoli silty clay loam, 0 to 2	inic-toanty	2.00	dramed	13	An areas are prime fariniand	1	INO	NO	INO	INO	Moderate	INO
Laydown Yard	0.48	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Laydown Tard	0.40	WIJIJA	Marquis silt loam, 1 to 3 percent	inic-toanty	1.00	Moderately well	10	Trinic farmiand if dramed	Z W	1 05	110	110	110	Severe	110
O&M Building	0.38	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Octivi Bunding	0.50	14130771	Readlyn silt loam, 1 to 3 percent	Time rounty	2.00	Somewhat poorly	17	7 in areas are prime farimana	20	110	110	110	110	Wiodelate	110
O&M Building	0.67	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
occivi Bunding	0.07	11101111	Tripoli silty clay loam, 0 to 2	inic rounty	2.00	urumeu	10	7 m areas are prime farmana	1	110	110	110	110	Moderate	110
O&M Building	1.57	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
See Bunding	1.0 /	1110 1011	Clyde silty clay loam, 0 to 3		1.00	Tooliy wiwiiid	10			1 33	110	1.0	1,0	201020	1,0
Stormwater Basin	2.32	M517A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
			Clyde-Floyd complex, 1 to 4	,		<u> </u>				1		1	<u> </u>	1	
Stormwater Basin	5.06	M518B	percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
			Coland-Spillville complex, 0 to 2	,		<u> </u>								1	
Stormwater Basin	0.03	1027A	percent slopes, flooded	fine-loamy	1.00	Poorly drained	32	Not prime farmland	5w	Yes	No	No	No	Severe	No
			Kasson silt loam, 2 to 6 percent	, , , , , , , , , , , , , , , , , , ,		Moderately well		·							
Stormwater Basin	0.86	M506B	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Nasset-Winneshiek complex, 12 to	•				•							
			18 percent slopes, moderately												
Stormwater Basin	0.06	M527D2	eroded	fine-silty	15.00	Well drained	6	Not prime farmland	4e	No	Yes	No	No	Moderate	No
			Oran silt loam, 1 to 4 percent	•		Somewhat poorly		-							
Stormwater Basin	0.57	M508A	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Readlyn silt loam, 1 to 3 percent			Somewhat poorly									
Stormwater Basin	2.13	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Tripoli silty clay loam, 0 to 2												
Stormwater Basin	5.07	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
			Winneshiek silt loam, 2 to 6												
Stormwater Basin	0.16	M526B	percent slopes	fine-loamy	4.00	Well drained	7	All areas are prime farmland	2e	No	No	No	No	Moderate	No

	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit			\$	Selected Soil Physic	al Features		Se	lected Soil Class	ifications			/Reclamation and Limitatio	Interpretations ons
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³	Hydric Soil Rating ³	Highly Erodible Water ⁷	Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹
Stormwater Basin	0.30	M526C2	Winneshiek silt loam, 6 to 12 percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Substation	2.40	M507A	Marquis silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Moderately well drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Substation	2.40	WIJO/A	Readlyn silt loam, 1 to 3 percent	inic-toamy	2.00	Somewhat poorly	19	An areas are prime farinand	20	110	110	110	110	Wioderate	110
Substation	4.44	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Transmission Line	2.13	M518B	Clyde-Floyd complex, 1 to 4 percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Transmission Line	1.21	176	Garwin silty clay loam	fine-silty	1.00	Poorly drained Somewhat poorly	13	Prime farmland if drained	2w	Yes	No	No	Yes	Severe	No
Transmission Line	0.22	203	Joy silt loam, 1 to 4 percent slopes	fine-silty	2.00	drained	20	All areas are prime farmland	2e	No	No	No	Yes	Moderate	No
Transmission Line	0.73	N514B	Joy-Ossian, occasionally flooded, complex, 1 to 5 percent slopes	fine-silty	3.00	Somewhat poorly drained	17	Prime farmland if protected from flooding or not frequently flooded during the growing season	1	No	No	No	Yes	Moderate	No
Transmission Line	0.73	NJITD	Marquis silt loam, 1 to 3 percent	inic-sitty	3.00	Moderately well	17	Scason	1	140	110	110	103	Wiodciate	110
Transmission Line	2.63	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Transmission Line	0.28	285A	Port Byron silt loam, 0 to 2 percent slopes	fine-silty	1.00	Well drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Transmission Line	0.91	285B	Port Byron silt loam, 2 to 6 percent slopes	fine-silty	4.00	Well drained	15	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Transmission Line	0.34	285C	Port Byron silt loam, 6 to 12 percent slopes, moderately eroded	fine-silty	8.00	Well drained	15	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Transmission Line	4.09	M511A	Readlyn silt loam, 1 to 3 percent slopes	fine-loamy	2.00	Somewhat poorly drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Transmission Eme	1.05	11101111	Tama-Dinsmore complex, 2 to 6	inic rouniy	2.00	Gramea	10	7111 drous are prime farimana	1	110	110	110	110	Wiodelate	110
Transmission Line	2.89	N555B	percent slopes	fine-silty	4.00	Well drained	13	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Transmission Line	1.99	M515A	Tripoli silty clay loam, 0 to 2 percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Transmission	1.77	14131371	Clyde-Floyd complex, 1 to 4	inic-todiny	1.00	1 oorry dramed	10	1 Time farmand it dramed		103	140	110	110	Bevere	110
ROW	4.08	M518B	percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
Transmission ROW	2.33	176	Garwin silty clay loam	fine-silty	1.00	Poorly drained	13	Prime farmland if drained	2w	Yes	No	No	Yes	Severe	No
Transmission	2.33	170	Garwin sirty ciay toani	illie-stity	1.00	Somewhat poorly	13	Frime farmand if dramed	ZW	1 es	INO	NO	1 68	Severe	INO
ROW	0.39	203	Joy silt loam, 1 to 4 percent slopes	fine-silty	2.00	drained	20	All areas are prime farmland	2e	No	No	No	Yes	Moderate	No
Transmission	1.55	NI5 1 4 D	Joy-Ossian, occasionally flooded,	5	2.00	Somewhat poorly drained	17	Prime farmland if protected from flooding or not frequently flooded during the growing	1	N.	N.	NI-	V	Madama	N.
ROW Transmission	1.55	N514B	complex, 1 to 5 percent slopes Marquis silt loam, 1 to 3 percent	fine-silty	3.00	Moderately well	17	season	1	No	No	No	Yes	Moderate	No
ROW	5.40	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Transmission ROW	0.03	493C	Oronoco loam, 6 to 12 percent slopes	coarse-loamy	8.00	Well drained	11	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
Transmission		2054	Port Byron silt loam, 0 to 2 percent	c 11.	1.00	337 11 1 1 1	1.5		,					M	
ROW Transmission	0.58	285A	slopes Port Byron silt loam, 2 to 6 percent	fine-silty	1.00	Well drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
ROW	2.11	285B	slopes	fine-silty	4.00	Well drained	15	All areas are prime farmland	2e	No	No	No	No	Moderate	No

	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit				Selected Soil Physic	al Features		Se	elected Soil Class	ifications			/Reclamation and Limitation	Interpretations ns
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³			Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹
Transmission			Port Byron silt loam, 6 to 12					Farmland of statewide							
ROW	0.60	285C	percent slopes, moderately eroded	fine-silty	8.00	Well drained	15	importance	3e	No	No	No	No	Moderate	No
Transmission			Readlyn silt loam, 1 to 3 percent			Somewhat poorly									
ROW	8.45	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
Transmission			Tama-Dinsmore complex, 2 to 6						_						
ROW	5.82	N555B	percent slopes	fine-silty	4.00	Well drained	13	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Transmission	2.05	3.4515 A	Tripoli silty clay loam, 0 to 2	C 1	1.00	D 1 1 ' 1	10	D: C 1 1:C1 : 1	2	37	N.T	N	NT.	G	N.T.
ROW	3.95	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
			Barremills silt loam, drainageway, 1 to 5 percent slopes, occasionally												
Undeveloped Area	1.97	N578B	flooded	fine-silty	3.00	Well drained	27	All areas are prime farmland	2e	No	No	No	No	Severe	No
Ondeveloped Area	1.97	N3/6 D	Bassett-Kasson complex, 6 to 12	inic-sitty	3.00	Moderately well	21	Farmland of statewide	26	110	INO	NO	INO	Severe	INO
Undeveloped Area	0.58	M523C2	percent slopes, eroded	fine-loamy	8.00	drained	7	importance	3e	No	No	No	No	Moderate	No
Chaevelopea 7 irea	0.50	14132302	Clyde silty clay loam, 0 to 3	inic rounty	0.00	dramed	<u>'</u>	ппротипсе	30	110	110	110	110	Wioderate	110
Undeveloped Area	9.10	M517A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
1			Clyde-Floyd complex, 1 to 4	J											
Undeveloped Area	45.46	M518B	percent slopes	fine-loamy	2.00	Poorly drained	23	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
•			Coland-Spillville complex, 0 to 2	·											
Undeveloped Area	10.35	1027A	percent slopes, flooded	fine-loamy	1.00	Poorly drained	32	Not prime farmland	5w	Yes	No	No	No	Severe	No
			Kasson silt loam, 2 to 6 percent	·		Moderately well									
Undeveloped Area	24.46	M506B	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Mantorville loam, 6 to 12 percent	fine-loamy over sandy or				Farmland of statewide							
Undeveloped Area	0.09	M509C2	slopes, moderately eroded	sandy-skeletal	9.00		15	importance	3e	No	No	No	No	Moderate	No
		_	Marquis silt loam, 1 to 3 percent			Moderately well									
Undeveloped Area	23.73	M507A	slopes	fine-loamy	2.00	drained	19	All areas are prime farmland	2e	No	No	No	No	Moderate	No
			Nasset-Winneshiek complex, 12 to												
TT 1 1 1 A	1.60	M527D2	18 percent slopes, moderately	C 11,	15.00	337 11 1 1 1		N	4	N	37	N	N.T.	N 1 4	N.T.
Undeveloped Area	1.60	M527D2	eroded Oran silt loam, 1 to 4 percent	fine-silty	15.00	Well drained Somewhat poorly	6	Not prime farmland	4e	No	Yes	No	No	Moderate	No
Undeveloped Area	11.45	M508A	slopes	fine-loamy	3.00	drained	8	All areas are prime farmland	1	No	No	No	No	Moderate	No
Ondeveloped Area	11.73	WIJOOA	Readlyn silt loam, 1 to 3 percent	inic-toanty	3.00	Somewhat poorly		An areas are prime fariniand	1	110	110	110	110	Wiodciate	140
Undeveloped Area	62.72	M511A	slopes	fine-loamy	2.00		15	All areas are prime farmland	1	No	No	No	No	Moderate	No
ondeveloped / ned	02.72	10131111	Readlyn silt loam, 1 to 3 percent	inic rounty	2.00	Somewhat poorly		Till areas are prime tariniana	1	110	110	110	110	Wioderate	110
Undeveloped Area	0.00	M511A	slopes	fine-loamy	2.00	drained	15	All areas are prime farmland	1	No	No	No	No	Moderate	No
			Tripoli silty clay loam, 0 to 2					•							
Undeveloped Area	31.48	M515A	percent slopes	fine-loamy	1.00	Poorly drained	18	Prime farmland if drained	2w	Yes	No	No	No	Severe	No
	310		Winneshiek silt loam, 2 to 6		1.00					1 22	0		1		
Undeveloped Area	18.04	M526B	percent slopes	fine-loamy	4.00	Well drained	7	All areas are prime farmland	2e	No	No	No	No	Moderate	No
Undeveloped Area	7.37	M526C2	Winneshiek silt loam, 6 to 12 percent slopes, moderately eroded	fine-loamy	8.00	Well drained	7	Farmland of statewide importance	3e	No	No	No	No	Moderate	No
			· - · · · · · · · · · · · · · · · · · ·	•						•					·


	Appendix A: Selected Soil Physical Features, Classifications, and Interpretations and Limitations														
		Map Unit			Selected Soil Physical Features				Selected Soil Classifications				Construction/Reclamation Interpretations and Limitations		
Feature Type	Acres ²	Symbol ³	Map Unit Name ³	Particle Size Family ³	Slope Range ⁴	Drainage Class ⁵	Topsoil Thickness (in) ⁶	Prime Farmland ³	Land Capability Classification ³	Hydric Soil Rating ³	Highly Erodible Water ⁷	Highly Erodible Wind ⁸	Compact Prone ⁹	Rutting Hazard ¹⁰	Droughty ¹¹

- Project Area include soils under Elk Creek Solar lease but that are not anticipated to be disturbed during construction or operations. Data obtained by merging facility polygons with the SSURGO spatial date in ArcGIS. Summations were performed in Microsoft Excel.
- Obtained directly by query of the SSURGO geospatial database.
- 4. Representative slope values are taken directly from the SSURGO database. The SSURGO database provides representative slope values for all component soil series. Slope classes represent the slope class grouping in percent that contains the representative slope value for a major component soil series. For example, a soil mapped in the 2-6% slope class has an average slope of 4%, which is within the 0-5% slope range.
- Drainage class as taken directly from the SSURGO database. ED, PD, and VPD indicate Excessively Drained, Poorly Drained, and Very Poorly Drained soils, respectively.
- Topsoil thickness is the aggregate thickness of the A horizons described in the SSURGO database.
- Includes soils in land capability classes 4e through 8e or that have a representative slope value greater than or equal to 9%.
- Includes soils in wind erodibility groups 1 and 2.
- Includes soils that are somewhat poorly drained to very poorly drained soils in loamy sands and finer textural classes.
- 10. Rutting potential hazard based on the soil strength as indicated by engineering texture classification, drainage class, and slope. In general, soils on low slopes in wetter drainage classes, and comprised of sediments with low strength will have potential rutting hazards.
- 11. Includes soils with a surface texture of sandy loam or coarser that are moderately well to excessively drained.

Appendix B NRCS Soils Map for the Project

Byron Solar ProjectDodge and Olmsted Counties, Minnesota



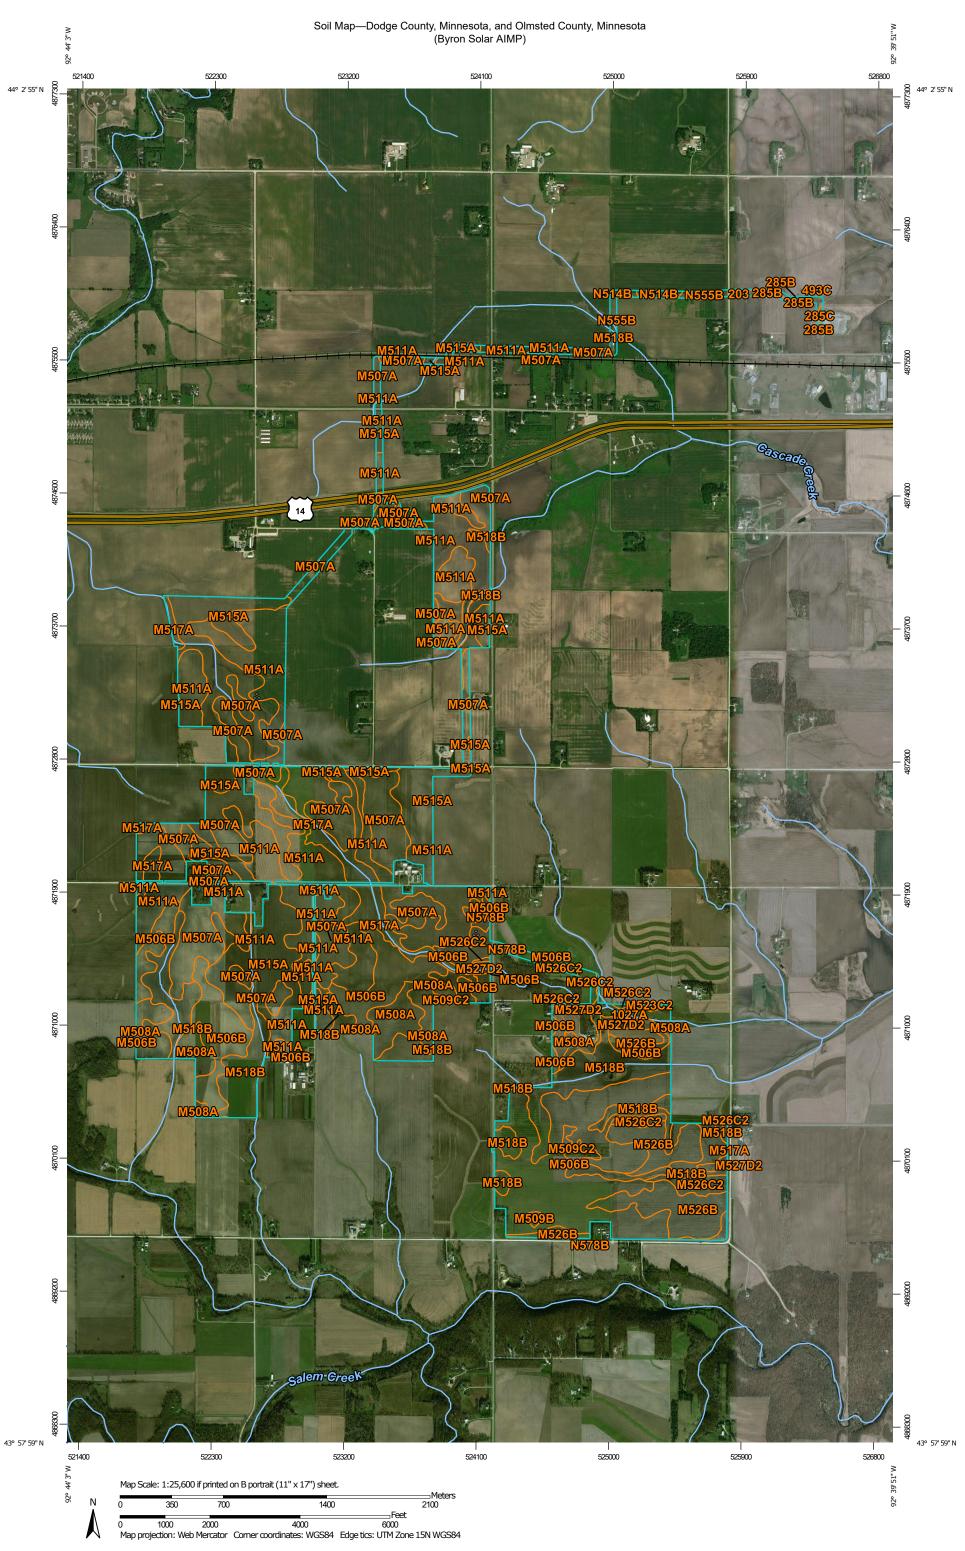

MAP LEGEND

å

00

Δ

Water Features

Transportation

Background

Spoil Area

Stony Spot

Wet Spot

Other

Rails

US Routes

Major Roads

Local Roads

Very Stony Spot

Special Line Features

Streams and Canals

Interstate Highways


Aerial Photography

Area of Interest (AOI)

Area of Interest (AOI)

Soils

Soil Map Unit Polygons



Soil Map Unit Points

Special Point Features

Blowout

Borrow Pit

Clay Spot

Closed Depression

Gravel Pit

Gravelly Spot

Landfill

Lava Flow

Marsh or swamp

Mine or Quarry

Miscellaneous Water

Perennial Water

Rock Outcrop

Saline Spot

Sandy Spot

Severely Eroded Spot

Sinkhole

Slide or Slip

Sodic Spot

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at scales ranging from 1:12.000 to 1:15.800.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Dodge County, Minnesota Survey Area Data: Version 17, Jun 5, 2020

Soil Survey Area: Olmsted County, Minnesota Survey Area Data: Version 15, Jun 5, 2020

Your area of interest (AOI) includes more than one soil survey area. These survey areas may have been mapped at different scales, with a different land use in mind, at different times, or at different levels of detail. This may result in map unit symbols, soil properties, and interpretations that do not completely agree across soil survey area boundaries.

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Oct 4, 2010—May 25, 2019

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI		
1027A	Coland, frequently flooded- Spillville, occasionally flooded complex, 0 to 2 percent slopes	11.9	0.6%		
M506B	Kasson silt loam, 2 to 6 percent slopes	368.4	19.9%		
M507A	Marquis silt loam, 1 to 3 percent slopes	239.4	12.9%		
M508A	Oran silt loam, 1 to 4 percent slopes	73.8	4.0%		
M509B	Mantorville loam, 2 to 6 percent slopes	2.1	0.1%		
M509C2	Mantorville loam, 6 to 12 percent slopes, moderately eroded	10.6	0.6%		
M511A	Readlyn silt loam, 1 to 3 percent slopes	449.9	24.3%		
M515A	Tripoli clay loam, 0 to 2 percent slopes	259.4	14.0%		
M517A	Clyde silty clay loam, 0 to 3 percent slopes	74.7	4.0%		
M518B	Clyde-Floyd complex, 1 to 4 percent slopes	184.6	10.0%		
M523C2	Bassett-Kasson complex, 6 to 12 percent slopes, eroded	0.7	0.0%		
M526B	Winneshiek silt loam, 2 to 6 percent slopes	106.6	5.8%		
M526C2	Winneshiek silt loam, 6 to 12 percent slopes, moderately eroded	40.1	2.2%		
M527D2	Nasset-Winneshiek complex, 12 to 18 percent slopes, moderately eroded	8.4	0.5%		
N514B	Joy-Ossian, occasionally flooded, complex, 1 to 5 percent slopes	2.3	0.1%		
N555B	Tama-Dinsmore complex, 2 to 6 percent slopes	8.7	0.5%		
N578B	Barremills silt loam, drainageway, 1 to 5 percent slopes, occasionally flooded	3.2	0.2%		
Subtotals for Soil Survey A	Area	1,844.8	99.5%		
Totals for Area of Interest		1,853.8	100.0%		

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
176	Garwin silty clay loam	3.5	0.2%
203	Joy silt loam, 1 to 4 percent slopes	0.6	0.0%
285A	Port Byron silt loam, 0 to 2 percent slopes	0.9	0.0%
285B	Port Byron silt loam, 2 to 6 percent slopes	3.0	0.2%
285C	Port Byron silt loam, 6 to 12 percent slopes, moderately eroded	0.9	0.1%
493C	Oronoco loam, 6 to 12 percent slopes	0.0	0.0%
M517A	Clyde silty clay loam, 0 to 3 percent slopes	0.0	0.0%
Subtotals for Soil Survey A	rea	9.0	0.5%
Totals for Area of Interest		1,853.8	100.0%

Appendix C Grading Heat Map

Byron Solar ProjectDodge and Olmsted Counties, Minnesota



